IN UNIMPROVED AREAS TAMPING SHALL NOT BE
REQUIRED. EXCESS MATERIAL SHALL BE MOUNDED UP.

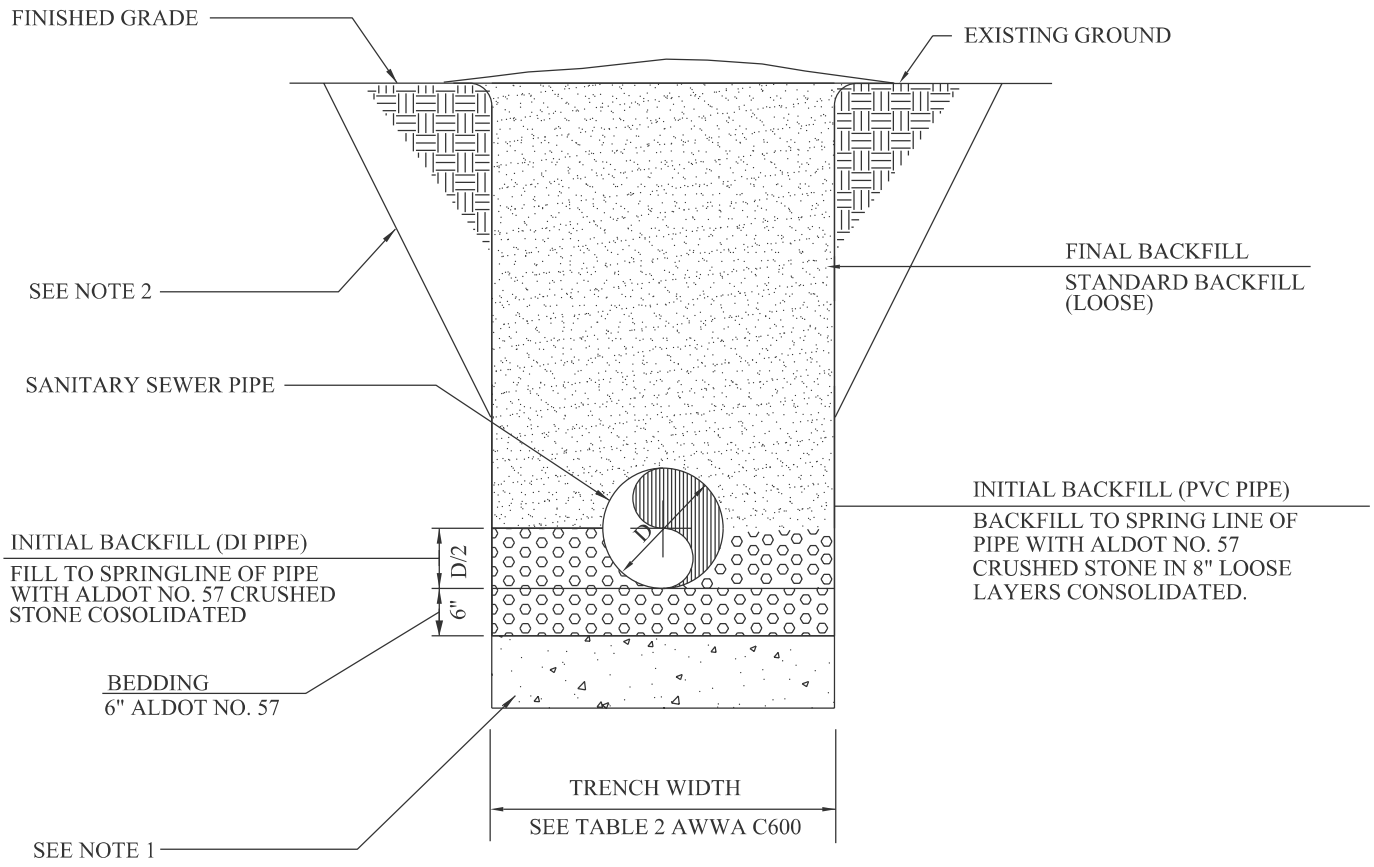

NOTES:

1.) TRENCH FOUNDATION REQUIRED IF DIRECTED BY ENGINEER. DEPTH VARIES.
2.) VERTICAL CUT TO EXTEND FROM TRENCH BOTTOM TO 1 FT ABOVE TOP OF PIPE.
SEE SPECIFICATIONS FOR SIDE SLOPE CONSTRUCTION OF ALL TRENCHES.
3.) STANDARD BACKFILL TO CONSIST OF NATIVE SOILS OF GOOD EARTH, SAND, AND GRAVEL,
AND SHALL BE FREE OF LARGE ROCKS AND OTHER DELETERIOUS SUBSTANCES.

AWWA C600 TABLE 2
TRENCH WIDTHS AT TOP OF PIPE

NOMINAL PIPE SIZE (INCHES)	TRENCH WIDTH (INCHES)
4	28
6	30
8	32
10	34
12	36
14	38
16	40
18	42

CITY OF TUSCALOOSA

TYPICAL TRENCH DETAIL
GRAVITY SEWERS - UNIMPROVED AREAS

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:	
DRAWN BY:	FES
DATE:	2011.01.05
SCALE:	NOT TO SCALE

APPROVED BY:
Jarrod D. Milligan, PE
Wastewater Engineer
CITY OF TUSCALOOSA

PAGE NO.
SD-005

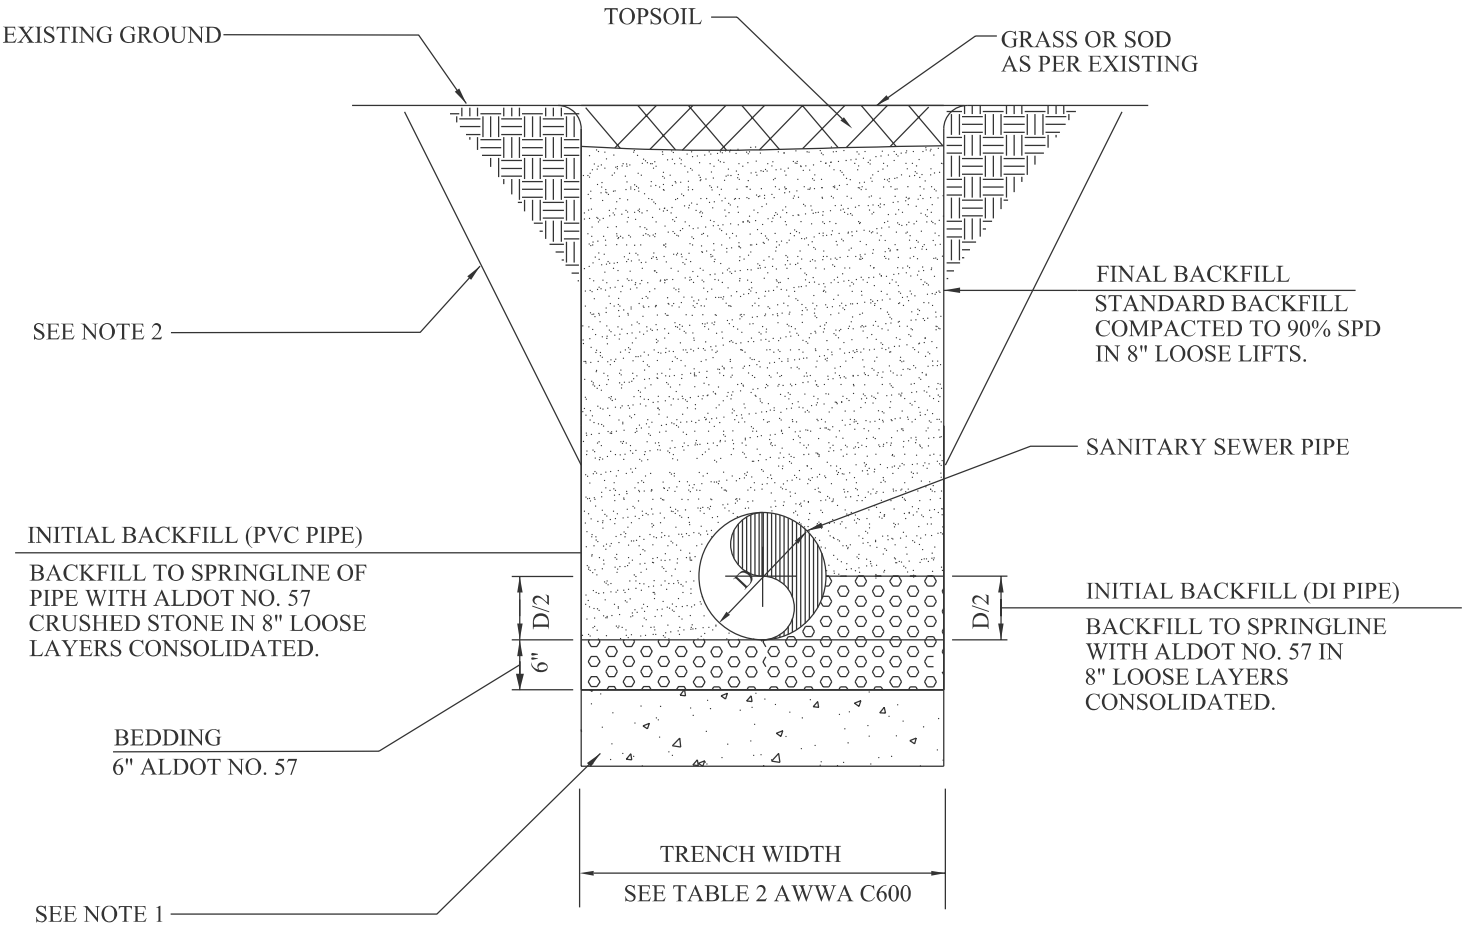

NOTES:

1.) TRENCH FOUNDATION REQUIRED IF DIRECTED BY ENGINEER. DEPTH VARIES.

2.) VERTICAL CUT TO EXTEND FROM TRENCH BOTTOM TO 1 FT ABOVE TOP OF PIPE. SEE SPECIFICATIONS FOR SIDE SLOPE CONSTRUCTION OF ALL TRENCHES.

3.) STANDARD BACKFILL TO CONSIST OF NATIVE SOILS OF GOOD EARTH, SAND, AND GRAVEL, AND SHALL BE FREE OF LARGE ROCKS AND OTHER DELETERIOUS SUBSTANCES.

4.) TOP 6" SHALL BE TOPSOIL FREE FROM ROCKS, ROOTS, ETC.

AWWA C600 TABLE 2
TRENCH WIDTHS AT TOP OF PIPE

NOMINAL PIPE SIZE (INCHES)	TRENCH WIDTH (INCHES)
4	28
6	30
8	32
10	34
12	36
14	38
16	40
18	42

CITY OF TUSCALOOSA

TYPICAL TRENCH DETAIL
GRAVITY SEWERS - IMPROVED AREAS

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY:	PAGE NO.
DRAWN BY:	FES	Jarrod D. Milligan, PE	SD-010
DATE:	2011.01.05	Wastewater Engineer	
SCALE:	NOT TO SCALE	CITY OF TUSCALOOSA	

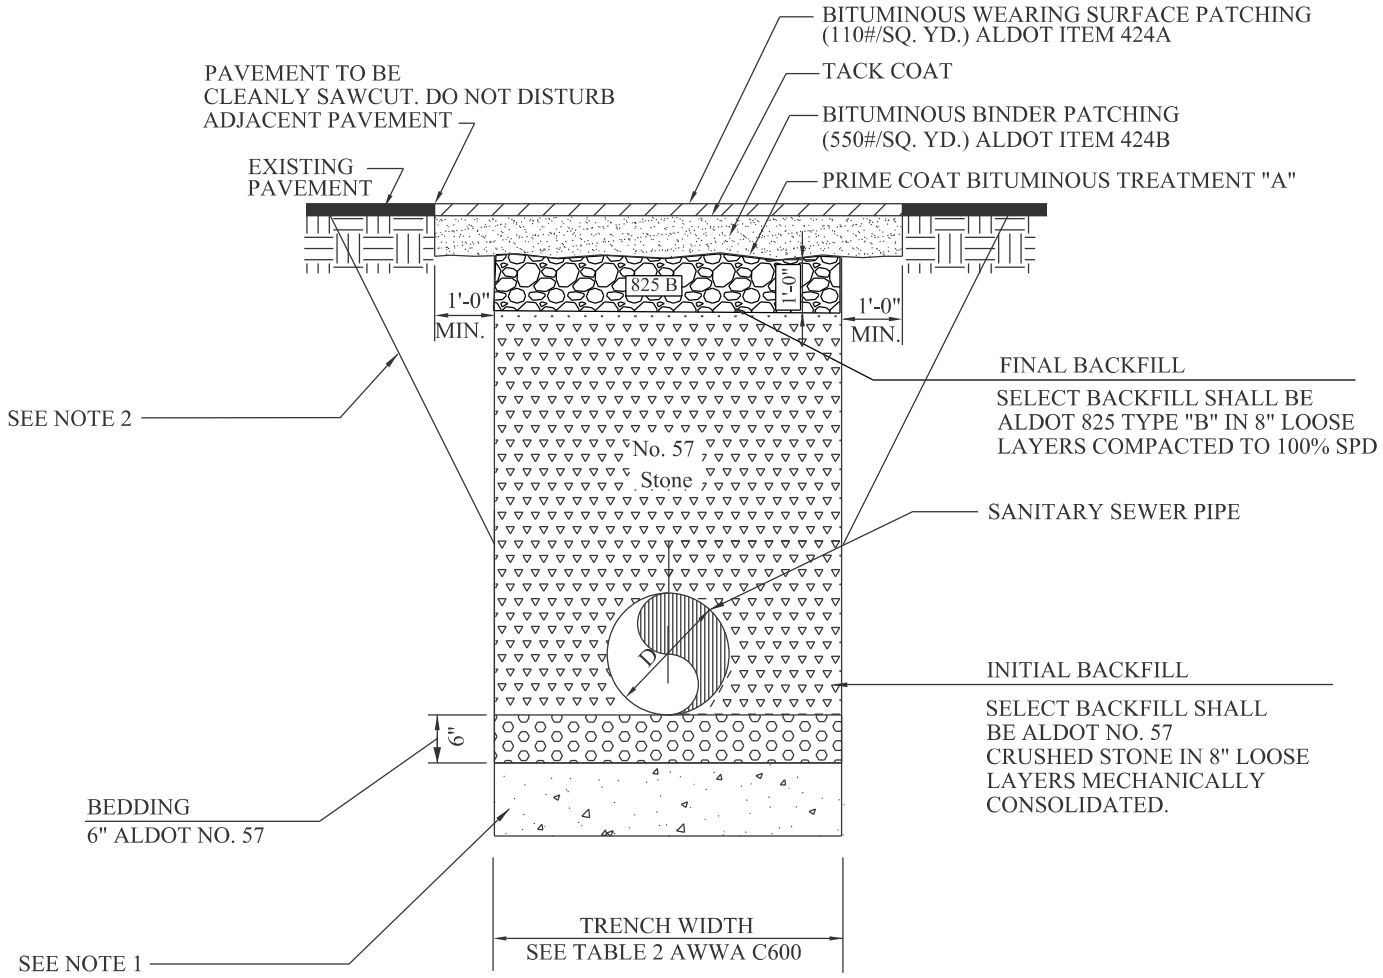

AWWA C600 TABLE 2
TRENCH WIDTHS AT TOP OF PIPE

NOMINAL PIPE SIZE (INCHES)	TRENCH WIDTH (INCHES)
4	28
6	30
8	32
10	34
12	36
14	38
16	40
18	42

NOTES:

1.) TRENCH FOUNDATION REQUIRED IF DIRECTED BY OCE. DEPTH VARIES.

2.) VERTICAL CUT TO EXTEND FROM TRENCH BOTTOM TO 1 FT ABOVE TOP OF PIPE. SEE SPECIFICATIONS FOR SIDE SLOPE CONSTRUCTION OF ALL TRENCHES.

3.) IF UTILITY RELOCATION FALLS WITHIN AN AREA THAT IS TO BE REMOVED DURING ROADWAY CONSTRUCTION, ELIMINATE THE WEARING SURFACE PATCHING AND MATCH THE BINDER PATCHING WITH EXISTING PAVEMENT.

TYPICAL TRENCH DETAIL
GRAVITY SEWERS - ASPHALT PAVING

REVISION		
DATE	DESCRIPTION	BY
1/11/18	REVISED BINDER LAYER TO 550# / SY	BMG

FILE NAME:		APPROVED BY:	PAGE NO.
DRAWN BY:		Jarrod D. Milligan, PE	SD - 015
DATE:		CITY OF TUSCALOOSA	
SCALE:	NOT TO SCALE		

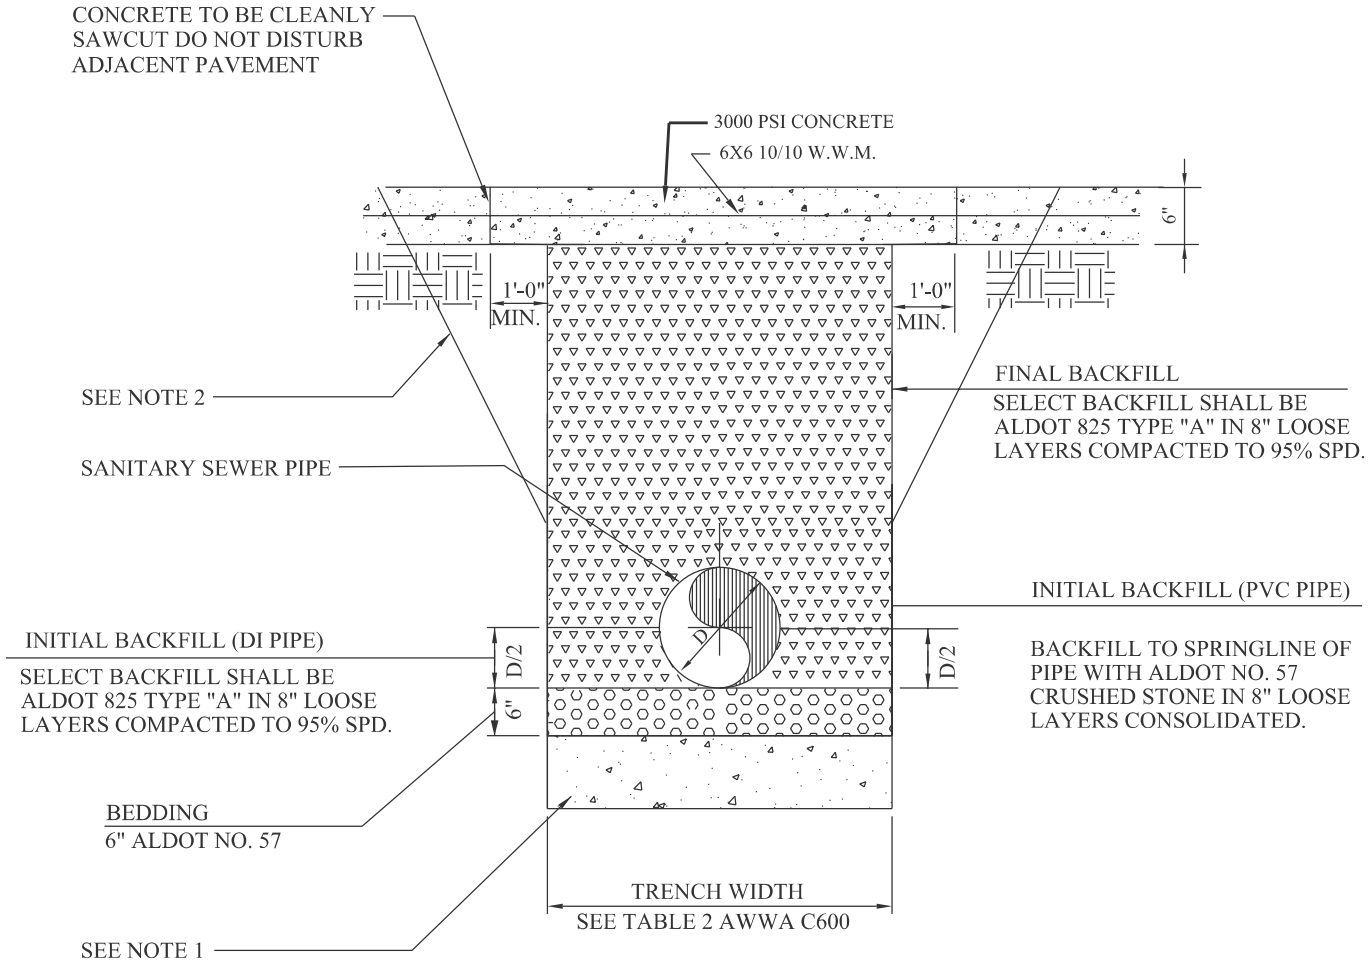

NOTES:

1.) TRENCH FOUNDATION REQUIRED IF DIRECTED BY ENGINEER. DEPTH VARIES.

2.) VERTICAL CUT TO EXTEND FROM TRENCH BOTTOM TO 1 FT ABOVE TOP OF PIPE. SEE SPECIFICATIONS FOR SIDE SLOPE CONSTRUCTION OF ALL TRENCHES.

AWWA C600 TABLE 2
TRENCH WIDTHS AT TOP OF PIPE

NOMINAL PIPE SIZE (INCHES)	TRENCH WIDTH (INCHES)
4	28
6	30
8	32
10	34
12	36
14	38
16	40
18	42

CITY OF TUSCALOOSA

TYPICAL TRENCH DETAIL
GRAVITY SEWERS - CONCRETE PAVING

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:	
DRAWN BY:	FES
DATE:	2011.01.05
SCALE:	NOT TO SCALE

APPROVED BY:
Jarrod D. Milligan, PE
Wastewater Engineer
CITY OF TUSCALOOSA

PAGE NO.
SD - 020

IN UNIMPROVED AREAS TAMPING SHALL NOT BE
REQUIRED. EXCESS MATERIAL SHALL BE MOUNDED UP.

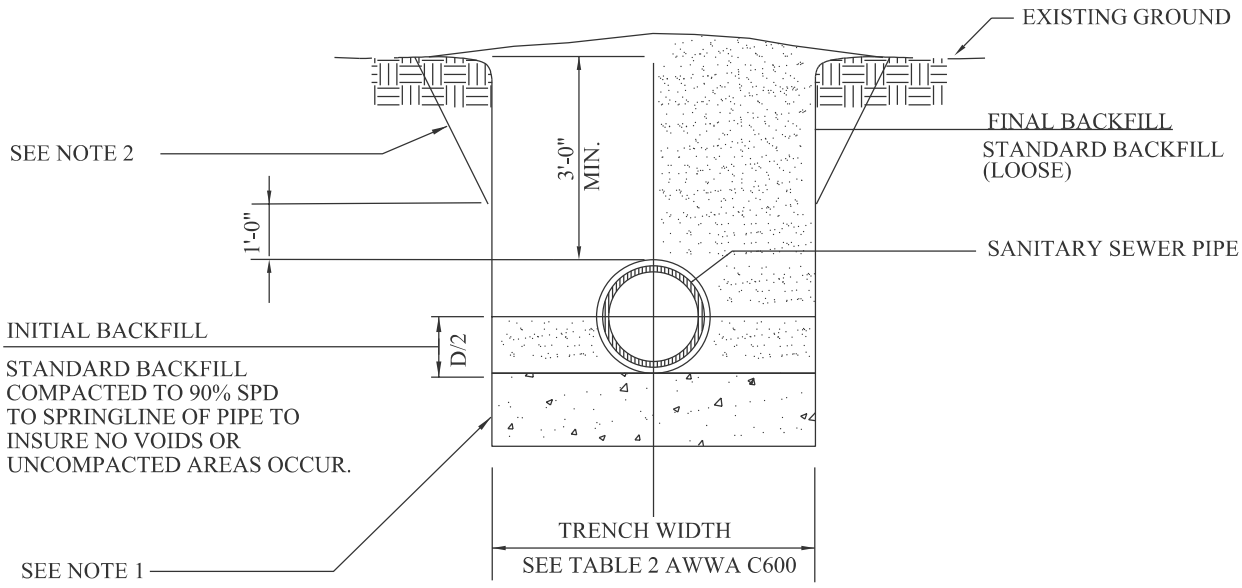

NOTES:

1.) PIPE TO BE BEDDED IN NATIVE SOIL, UNLESS SITE CONDITIONS REQUIRE OTHERWISE OR IF DIRECTED BY THE ENGINEER.
2.) VERTICAL CUT TO EXTEND FROM TRENCH BOTTOM TO 1 FT ABOVE TOP OF PIPE. SEE SPECIFICATIONS FOR SIDE SLOPE CONSTRUCTION OF ALL TRENCHES.
3.) FOR ALL PVC PIPE, INITIAL BACKFILL SHALL BE PLACED IN APPROPRIATE THICKNESSES AND COMPACTED IN THE FOLLOWING SEQUENCE
    1. SPRINGLINE OF PIPE
    2. ONE FOOT ABOVE TOP OF PIPE
4.) STANDARD BACKFILL TO CONSIST OF NATIVE SOILS OF GOOD EARTH, SAND, AND GRAVEL, AND SHALL BE FREE OF LARGE ROCKS AND OTHER DELETERIOUS SUBSTANCES.

AWWA C600 TABLE 2
TRENCH WIDTHS AT TOP OF PIPE

NOMINAL PIPE SIZE (INCHES)	TRENCH WIDTH (INCHES)
4	28
6	30
8	32
10	34
12	36
14	38
16	40
18	42

CITY OF TUSCALOOSA

TYPICAL TRENCH DETAIL
PRESSURE PIPE - UNIMPROVED AREAS

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY:	PAGE NO.
DRAWN BY:	FES	Jarrod D. Milligan, PE	SD - 025
DATE:	2011.01.05	Wastewater Engineer	
SCALE:	NOT TO SCALE	CITY OF TUSCALOOSA	

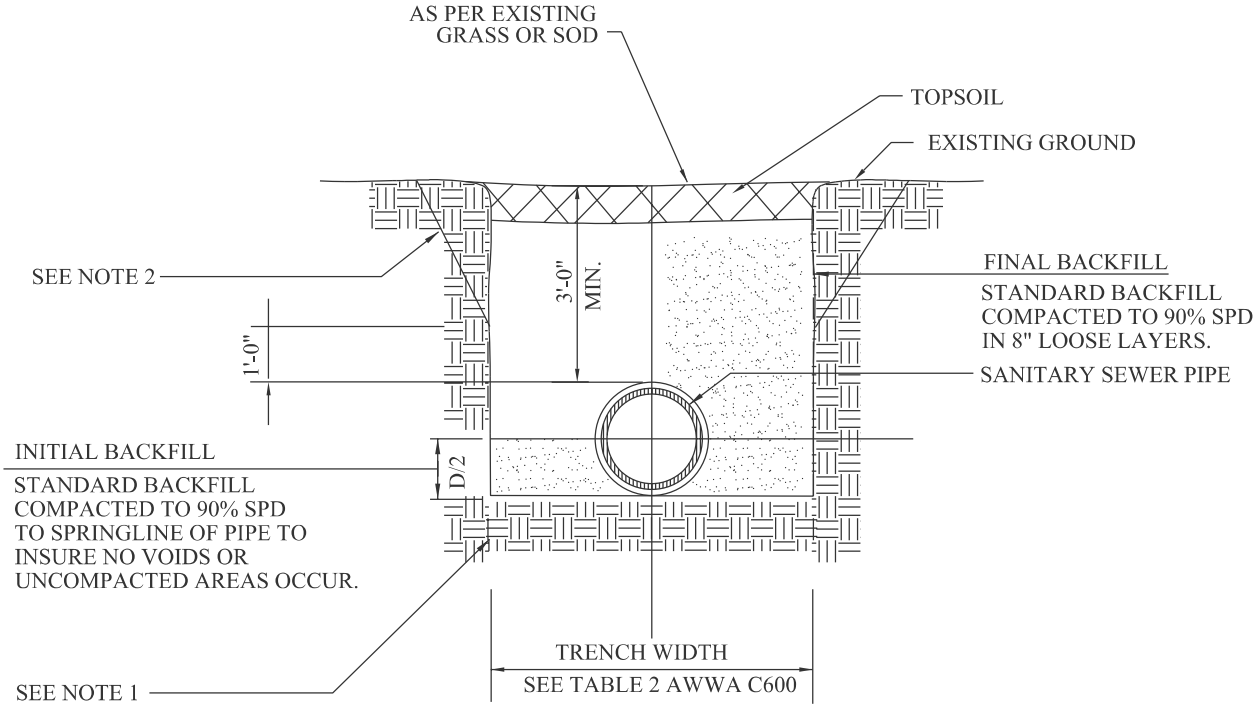

NOTES:

1.) PIPE TO BE BEDDED IN NATIVE SOIL, UNLESS SITE CONDITIONS REQUIRE OTHERWISE OR IF DIRECTED BY THE ENGINEER.
2.) VERTICAL CUT TO EXTEND FROM TRENCH BOTTOM TO 1 FT ABOVE TOP OF PIPE. SEE SPECIFICATIONS FOR SIDE SLOPE CONSTRUCTION OF ALL TRENCHES.
3.) FOR ALL PVC PIPE, INITIAL BACKFILL SHALL BE PLACED IN APPROPRIATE THICKNESSES AND COMPACTED IN THE FOLLOWING SEQUENCE
    1. SPRINGLINE OF PIPE
    2. ONE FOOT ABOVE TOP OF PIPE
4.) STANDARD BACKFILL TO CONSIST OF NATIVE SOILS OF GOOD EARTH, SAND, AND GRAVEL, AND SHALL BE FREE OF LARGE ROCKS AND OTHER DELETERIOUS SUBSTANCES.
5.) TOP 6" SHALL BE TOPSOIL FREE FROM ROCKS, ROOTS, ETC.

AWWA C600 TABLE 2
TRENCH WIDTHS AT TOP OF PIPE

NOMINAL PIPE SIZE (INCHES)	TRENCH WIDTH (INCHES)
4	28
6	30
8	32
10	34
12	36
14	38
16	40
18	42

CITY OF TUSCALOOSA

TYPICAL TRENCH DETAIL PRESSURE PIPE - IMPROVED AREAS

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY: Jarrod D. Milligan, PE Wastewater Engineer CITY OF TUSCALOOSA	PAGE NO. SD - 030
DRAWN BY:	FES		
DATE:	2011.01.05		
SCALE:	NOT TO SCALE		

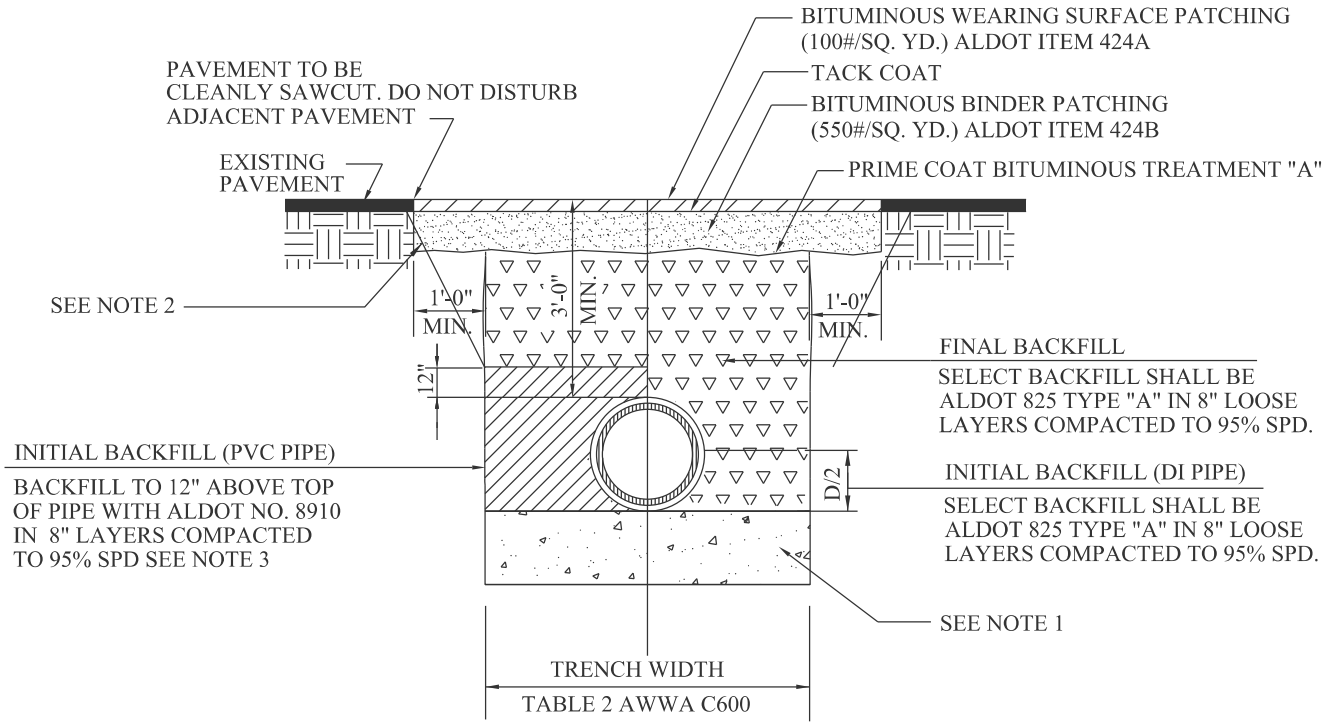

NOTES:

1.) PIPE TO BE BEDDED IN NATIVE SOIL, UNLESS SITE CONDITIONS REQUIRE OTHERWISE OR IF DIRECTED BY THE ENGINEER.

2.) VERTICAL CUT TO EXTEND FROM TRENCH BOTTOM TO 1 FT ABOVE TOP OF PIPE. SEE SPECIFICATIONS FOR SIDE SLOPE CONSTRUCTION OF ALL TRENCHES.

3.) FOR ALL PVC PIPE, INITIAL BACKFILL SHALL BE PLACED IN APPROPRIATE THICKNESSES AND COMPACTED IN THE FOLLOWING SEQUENCE
   1. SPRINGLINE OF PIPE
   2. ONE FOOT ABOVE TOP OF PIPE

4.) IF UTILITY LOCATION FALLS WITHIN AN AREA THAT IS TO BE REMOVED DURING ROADWAY CONSTRUCTION, ELIMINATE THE WEARING SURFACE ATCHING AND MATCH THE BINDER PATCHING WITH EXISTING PAVEMENT.

AWWA C600 TABLE 2
TRENCH WIDTHS AT TOP OF PIPE

NOMINAL PIPE SIZE (INCHES)	TRENCH WIDTH (INCHES)
4	28
6	30
8	32
10	34
12	36
14	38
16	40
18	42

TYPICAL TRENCH DETAIL
PRESSURE PIPE - CUT PAVEMENT & DRIVE X-ING

REVISION		
DATE	DESCRIPTION	BY

FILE NAME:	APPROVED BY:	PAGE NO.
DRAWN BY:		SD - 035
DATE:	Wastewater Engineer CITY OF TUSCALOOSA	
SCALE: NOT TO SCALE		

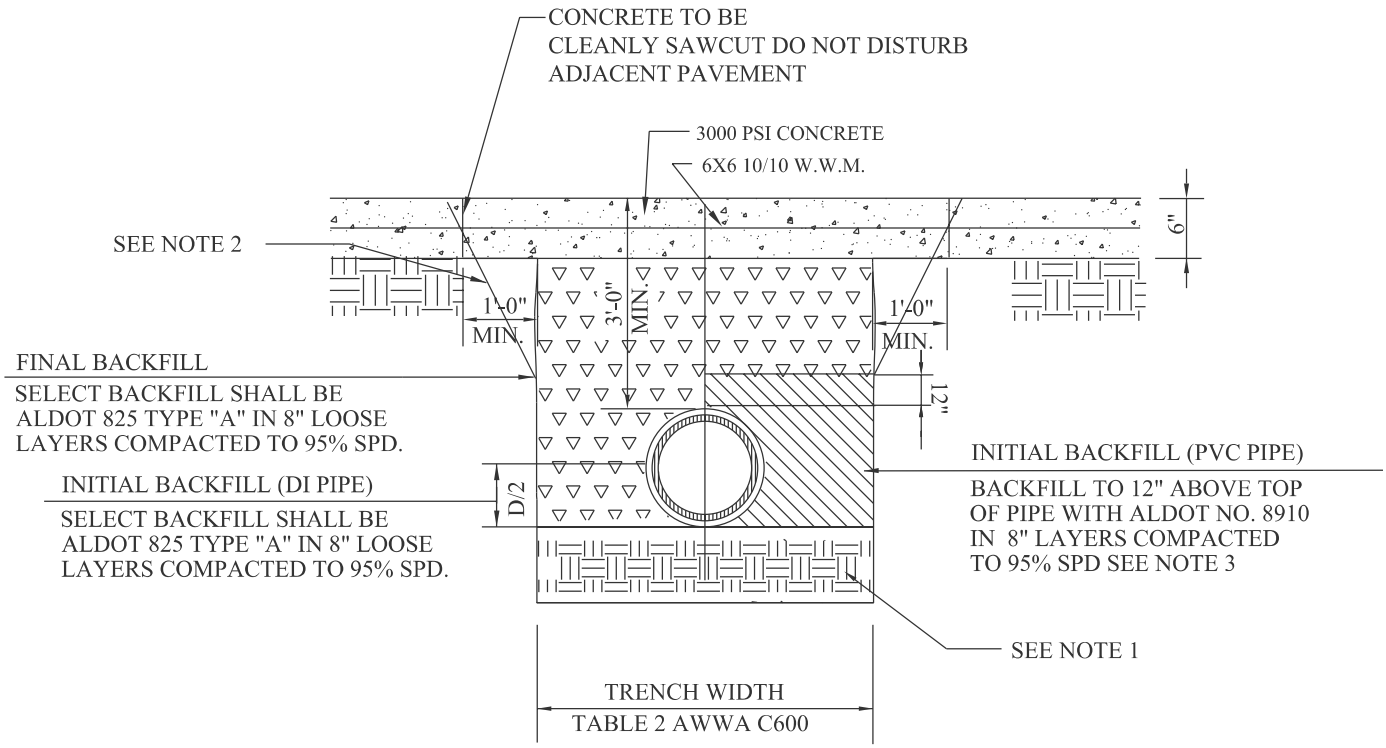

NOTES:

1.) PIPE TO BE BEDDED IN NATIVE SOIL, UNLESS SITE CONDITIONS REQUIRE OTHERWISE OR IF DIRECTED BY THE ENGINEER.

2.) VERTICAL CUT TO EXTEND FROM TRENCH BOTTOM TO 1 FT ABOVE TOP OF PIPE. SEE SPECIFICATIONS FOR SIDE SLOPE CONSTRUCTION OF ALL TRENCHES.

3.) FOR ALL PVC PIPE, INITIAL BACKFILL SHALL BE PLACED IN APPROPRIATE THICKNESSES AND COMPACTED IN THE FOLLOWING SEQUENCE
   1. SPRINGLINE OF PIPE
   2. ONE FOOT ABOVE TOP OF PIPE

AWWA C600 TABLE 2
TRENCH WIDTHS AT TOP OF PIPE

NOMINAL PIPE SIZE (INCHES)	TRENCH WIDTH (INCHES)
4	28
6	30
8	32
10	34
12	36
14	38
16	40
18	42

CITY OF TUSCALOOSA

TYPICAL TRENCH DETAIL
PRESSURE PIPE - CONCRETE DRIVE REPLACEMENT

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:	
DRAWN BY:	FES
DATE:	2011.01.05
SCALE:	NOT TO SCALE

APPROVED BY:
Jarrod D. Milligan, PE
Wastewater Engineer
CITY OF TUSCALOOSA

PAGE NO.
SD - 040

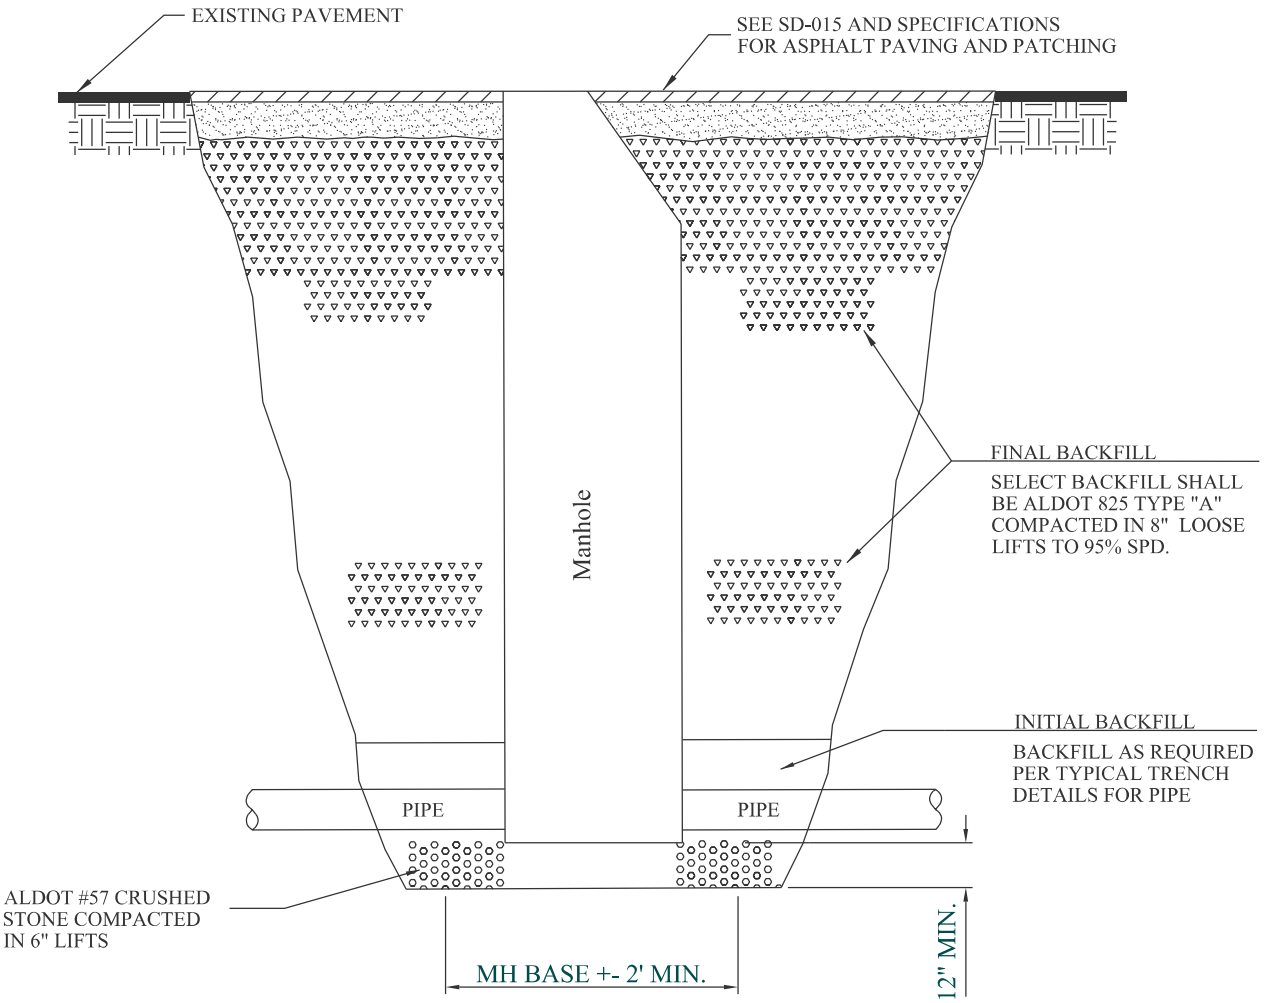

NOTES:

1) TRENCH FOUNDATION MATERIAL REQUIRED IF DIRECTED BY ENGINEER. MATERIAL TO BE ALDOT #57 STONE.

CITY OF TUSCALOOSA

BEDDING AND BACKFILL REQUIREMENTS AROUND MANHOLES IN TRAFFIC AREAS

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY: Jarrod D. Milligan, PE, Wastewater Engineer, CITY OF TUSCALOOSA	PAGE NO. SD-045
DRAWN BY:	FES		
DATE:	2011.01.05		
SCALE:	NOT TO SCALE		

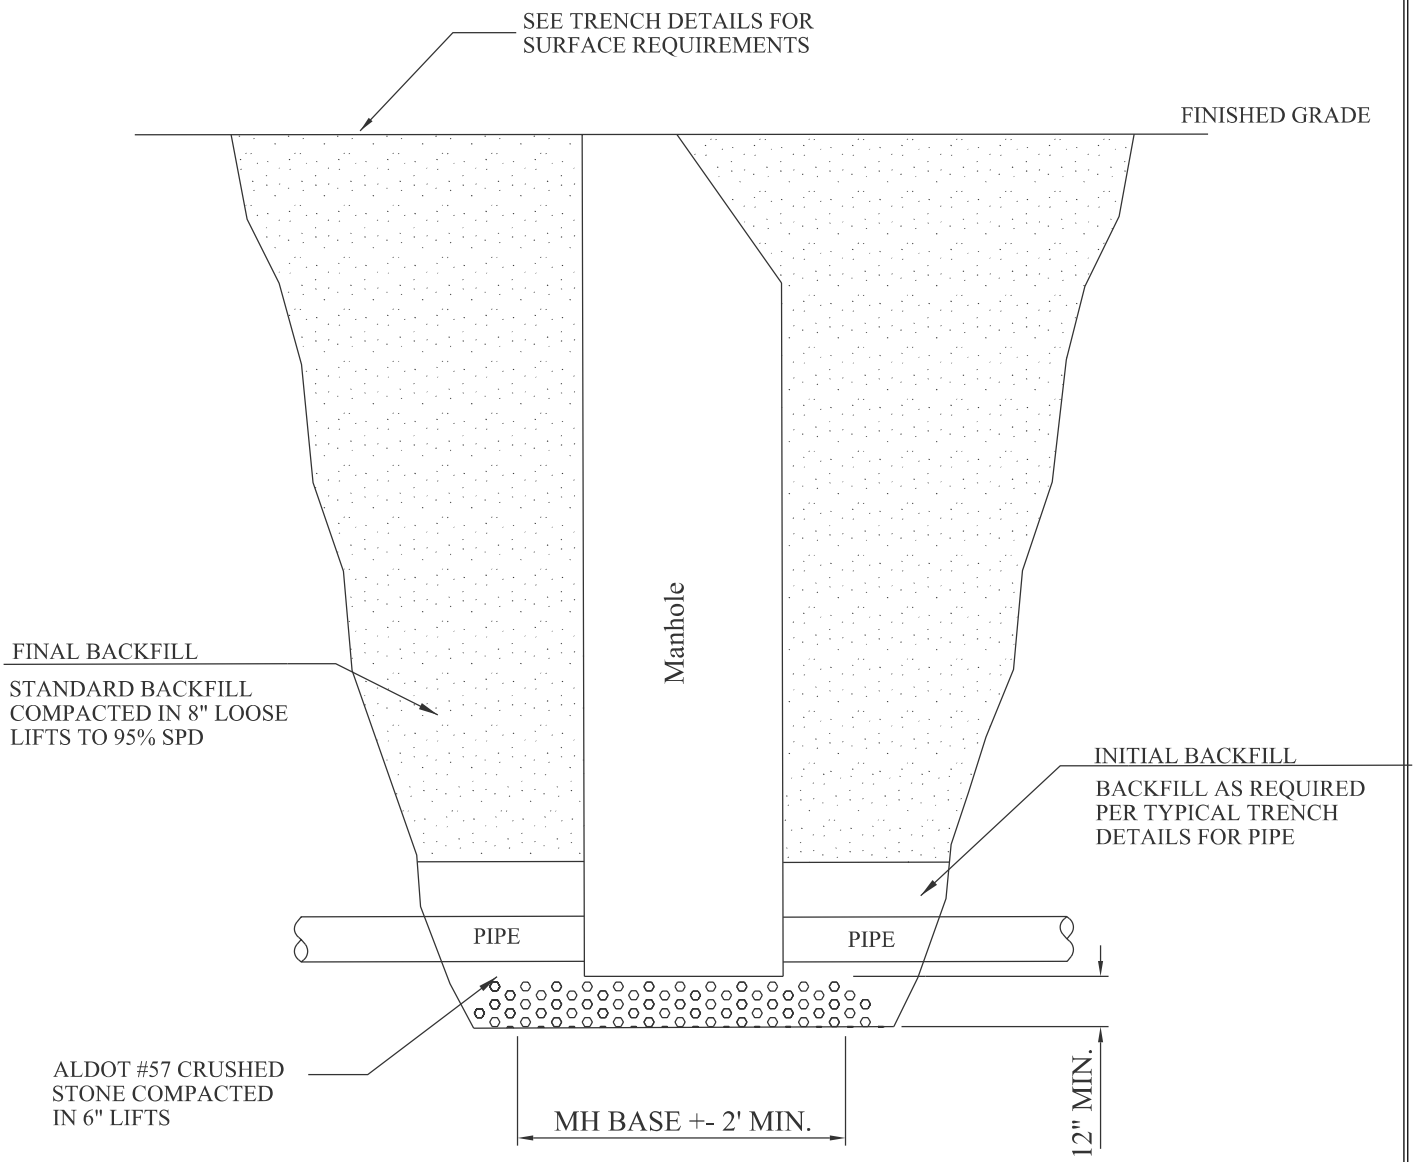

NOTES:

1) TRENCH FOUNDATION MATERIAL REQUIRED IF DIRECTED BY ENGINEER. MATERIAL TO BE ALDOT #57 STONE.
2) STANDARD BACKFILL SHALL BE NATIVE MATERIAL FREE OF LARGE ROCKS OR HARD MATERIAL.

CITY OF TUSCALOOSA

BEDDING AND BACKFILL REQUIREMENTS AROUND MANHOLES IN NON-TRAFFIC AREAS

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY: Jarrod D. Milligan, PE, Wastewater Engineer, CITY OF TUSCALOOSA	PAGE NO. SD-050
DRAWN BY:	FES		
DATE:	2011.01.05		
SCALE:	NOT TO SCALE		

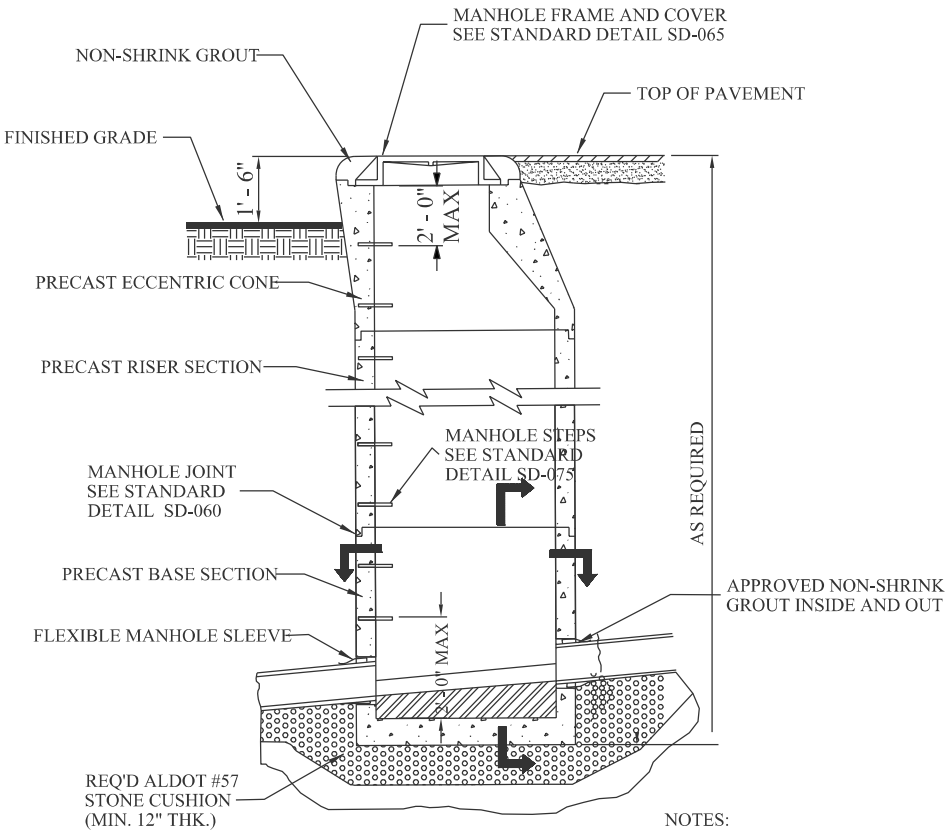

SECTION
N. T. S.

NOTES:

1) MANHOLES IN STREETS AND IMPROVED AREAS SHALL BE FINISHED FLUSH WITH FINISHED SURFACE. IN IMPROVED AREAS, 18" ABOVE FINISHED SURFACE OR AS DIRECTED BY ENGINEER.

2) FOR MANHOLE BACKFILL REQUIREMENTS REFER TO STANDARD DETAILS SD-045 AND SD-050.

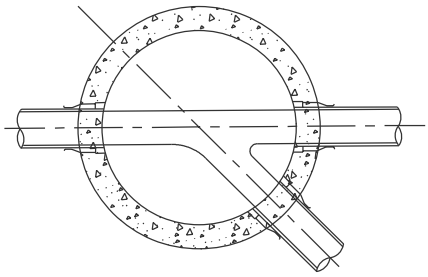

MANHOLE BASE PLAN
N. T. S.

NOTES:

1) PLACE STEPS ON LEAST OBSTRUCTED WALL.
2) MAX. DEFLECTION ANGLE OF SEWER ALIGNMENT = 90^
3) OPENINGS FOR PIPES TO BE FACTORY CAST OR CORED.

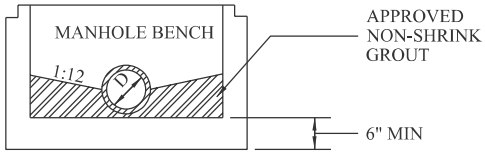

MANHOLE BASE SECTION
N. T. S.

NOTES:

1) BENCH REQUIRED FOR PIPE DIAMETER LESS THAN 48"
2) REFER TO STANDARD DETAIL SD-056 FOR DOGHOUSE MANHOLE BASE

CITY OF TUSCALOOSA

STD. PRECAST MANHOLE

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY: Jarrod D. Milligan, PE, Wastewater Engineer, CITY OF TUSCALOOSA	PAGE NO. SD - 055
DRAWN BY:	FES		
DATE:	2011.01.05		
SCALE:	NOT TO SCALE		

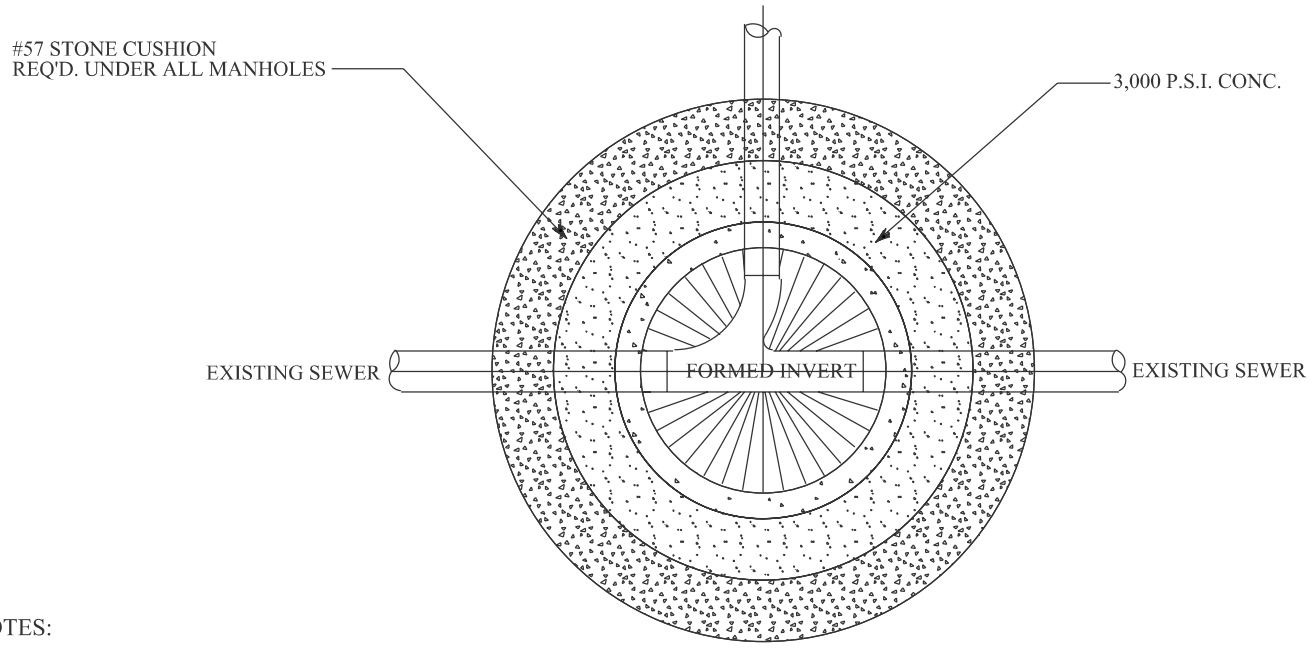

NOTES:

1) FOR MANHOLE BACKFILL REQUIREMENTS REFER TO STANDARD DETAILS SD-045 AND SD-050.

2) FOR PRECAST MANHOLE DETAILS REFER TO STANDARD DETAIL SD-055.

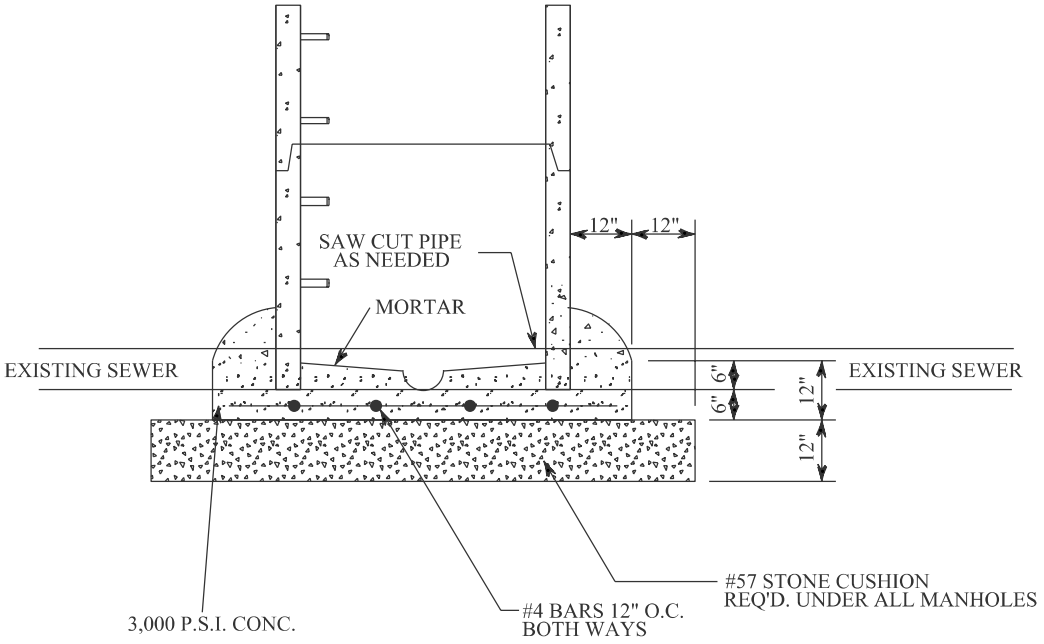

CITY OF TUSCALOOSA

DOGHOUSE MANHOLE BASE

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY:	PAGE NO.
DRAWN BY:	FES	Jarrod D. Milligan, PE Wastewater Engineer CITY OF TUSCALOOSA	SD - 056
DATE:	2011.01.05		
SCALE:	NOT TO SCALE		

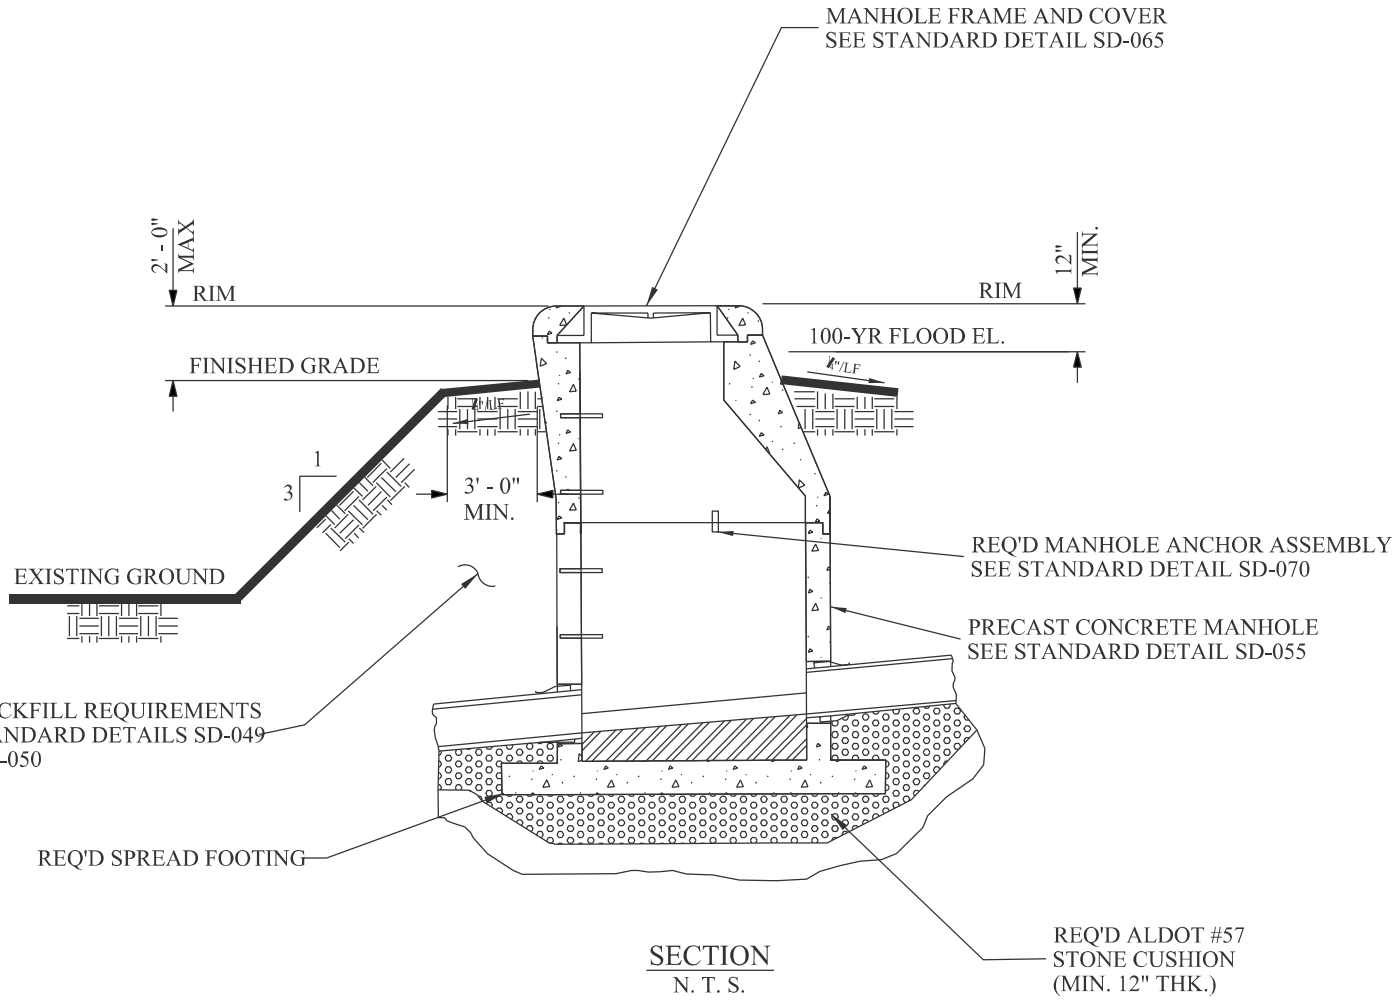

SECTION
N. T. S.

NOTES:

1) FOR MANHOLE BACKFILL REQUIREMENTS REFER TO STANDARD DETAILS SD-045 AND SD-050.

2) WHERE REQUIRED BY OCE, AN ACCESS ROAD SHALL BE CONSTRUCTED TO ALLOW ACCESS TO ALL MANHOLES.

3) SPREAD FOOTING DESIGN SHALL BE PROJECT SPECIFIC AND SHALL BE SUBMITTED FOR APPROVAL BY OCE.

4) WHERE RAISED MANHOLES ARE NOT ALLOWED, MANHOLES SHALL BE EQUIPPED WITH WATERTIGHT FRAMES AND COVERS REFER TO STANDARD DETAIL SD-070.

OCE
CITY OF TUSCALOOSA

MANHOLE IN 100 YR FLOOD ZONE AND/OR FILL AREA

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY: Jarrod D. Milligan, PE, Wastewater Engineer, CITY OF TUSCALOOSA	PAGE NO. SD - 057
DRAWN BY:	FES		
DATE:	2011.01.05		
SCALE:	NOT TO SCALE		

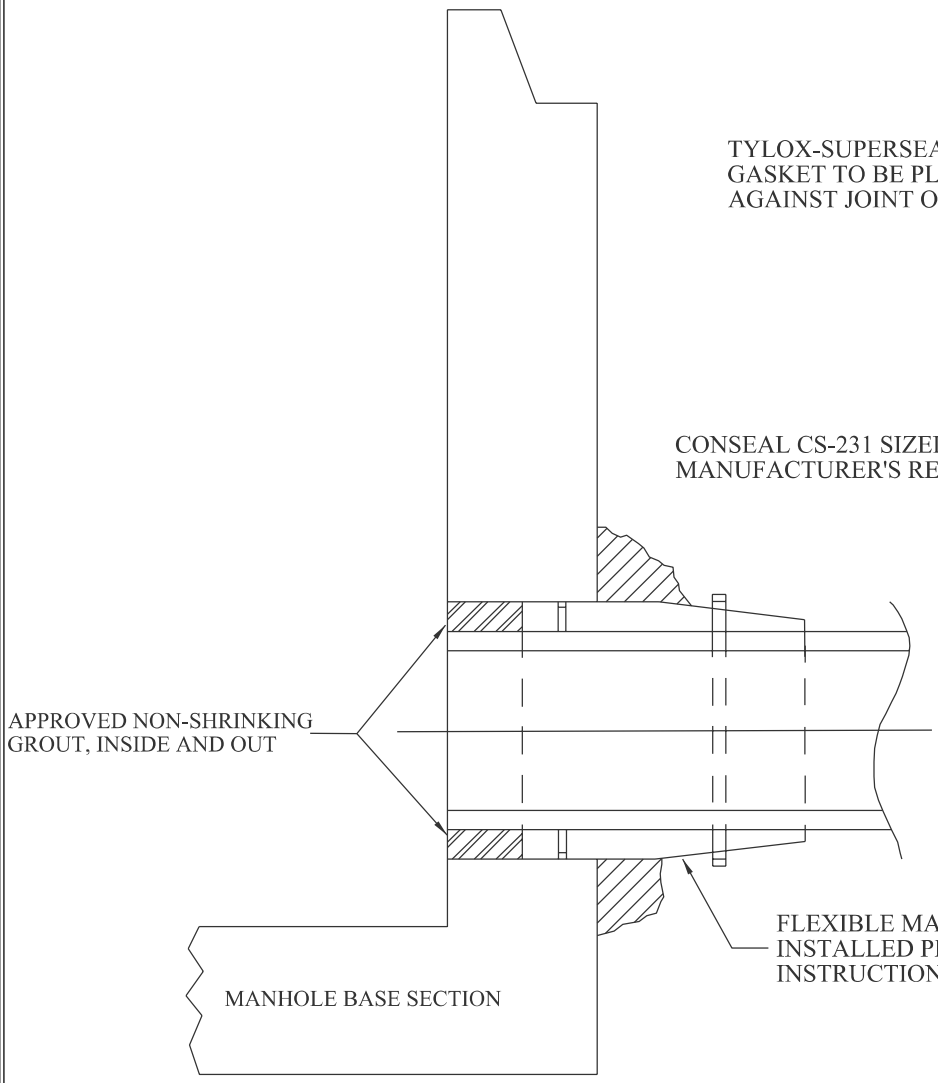

FLEXIBLE MANHOLE SLEEVE DETAIL

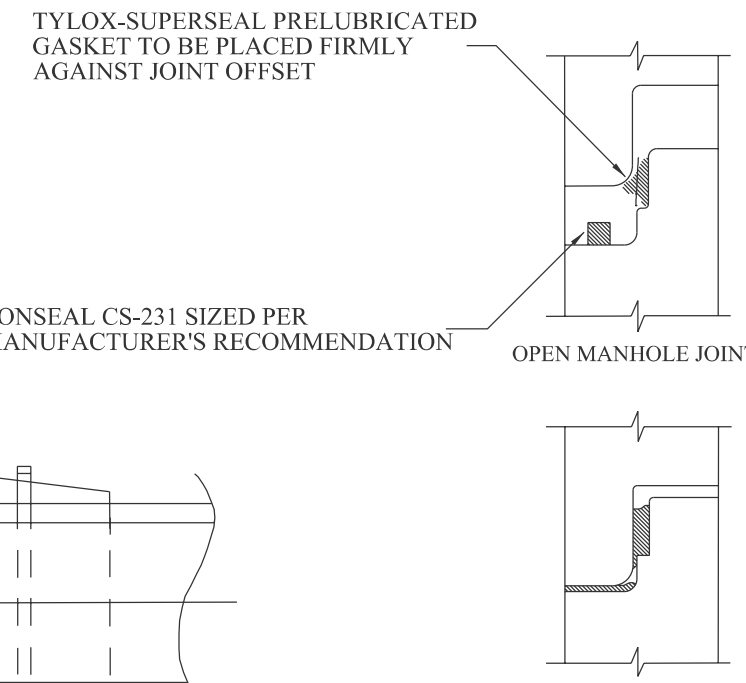

MANHOLE JOINT DETAIL

CITY OF TUSCALOOSA

FLEXIBLE MANHOLE SLEEVE AND MANHOLE JOINT DETAILS

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:	
DRAWN BY:	FES
DATE:	2011.01.05
SCALE:	NOT TO SCALE

APPROVED BY:
Jarrod D. Milligan, PE
Wastewater Engineer
CITY OF TUSCALOOSA

PAGE NO.
SD - 060

NOTE:

1. FRAME & COVER VULCAN FOUNDRY No. V-1344-1 OR U.S. FOUNDARY & MFG. CORP. CATALOG NUMBER USF 420 WITH CITY OF TUSCALOOSA LOGO OR APPROVED EQUAL

2. ALL CASTINGS SHALL BE CLEARLY MARKED WITH THE MANUFACTURER'S NAME, PRODUCT CATALOG NO. AND MADE IN THE U.S.A. IN CAST LETTERS

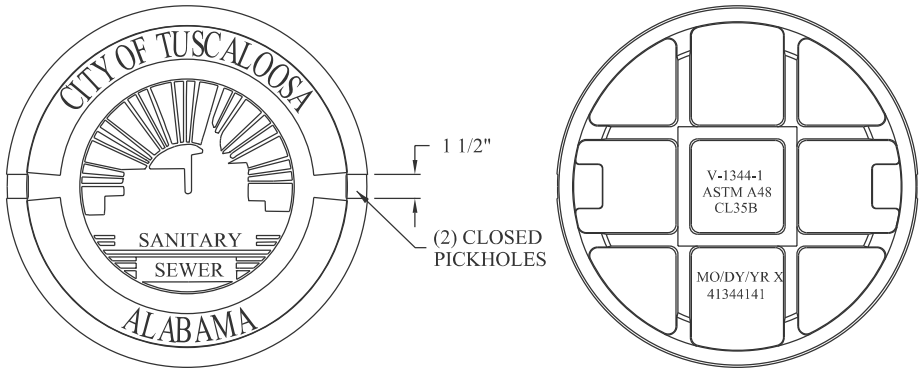

350 POUND RING AND COVER

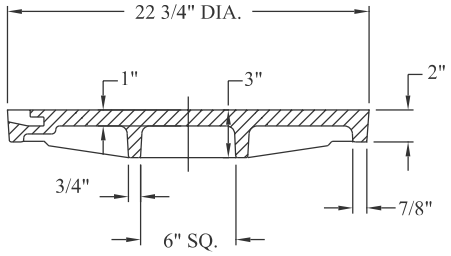

SECTION

STANDARD CONCRETE ADJUSTING RINGS. PLACE MINIMUM ½ INCH BED OF NON-SHRINK GROUT WITH BUTYL SEALANT WATERSTOP BETWEEN EACH LAYER. MAXIMUM COMBINED HEIGHT OF ADJUSTING RINGS SHALL BE 8 INCHES.

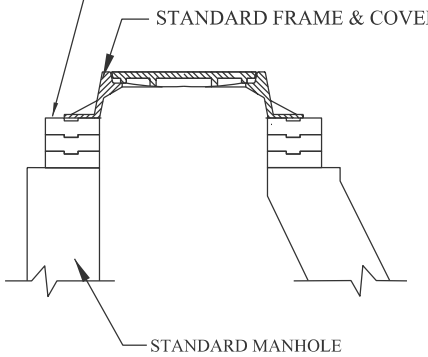

MANHOLE FRAME AND ADJUSTING RING DETAILS

NO SCALE

MANHOLE COVER DETAILS

CITY OF TUSCALOOSA

MANHOLE FRAME AND COVER AND ADJUSTING RING DETAILS

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY: Jarrod D. Milligan, PE, Wastewater Engineer, CITY OF TUSCALOOSA	PAGE NO. SD - 065
DRAWN BY:	FES		
DATE:	2011.01.05		
SCALE:	NOT TO SCALE		

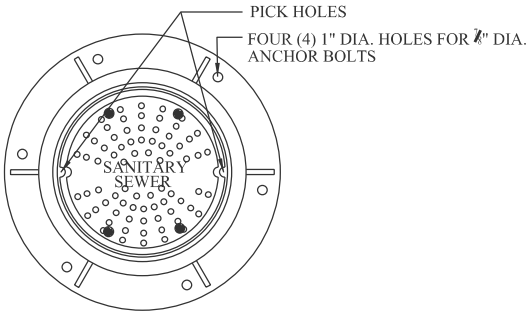

PLAN

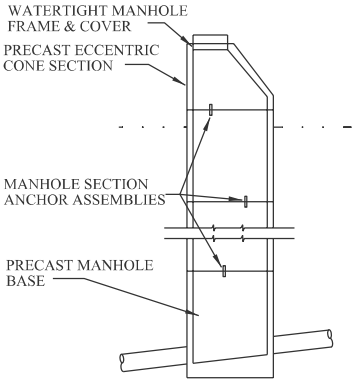

NOTE: MANHOLE COVER SHALL BE CAST IRON AS FURNISHED BY EJIW V-2358, USF 1452, OR APPROVED EQUAL. MANHOLE RIM AND COVER SHALL BE WATERTIGHT. APPROXIMATE WEIGHT OF FRAME & COVER - 350 LBS. MIN.

NOTE: MANHOLE SECTION ANCHOR ASSEMBLIES SHALL BE INSTALLED BETWEEN ALL PRECAST RISER SECTIONS AT EVERY MANHOLE WHERE WATERTIGHT MANHOLE FRAMES AND COVERS ARE SPECIFIED

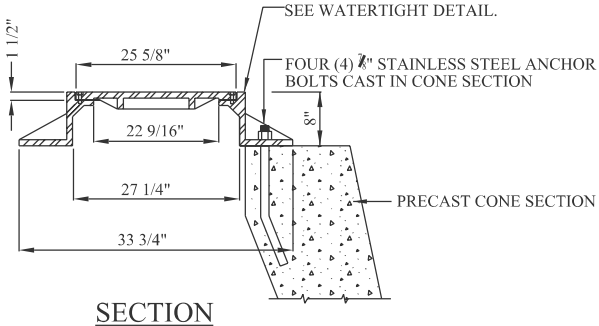

SECTION

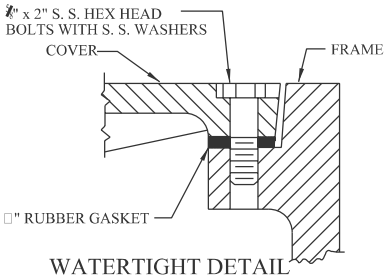

WATERTIGHT DETAIL

N. T. S.

WATERTIGHT MANHOLE COVER DETAILS

NO SCALE

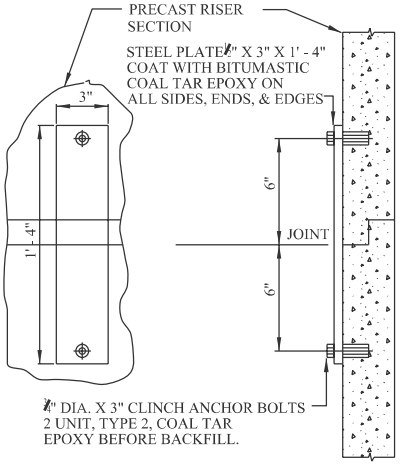

NOTE: 3 ANCHOR ASSEMBLIES REQUIRED PER JOINT 120^ APART.

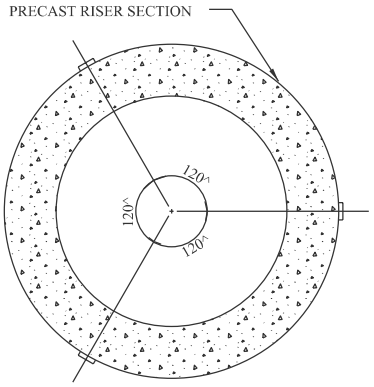

SECTION

CITY OF TUSCALOOSA

WATERTIGHT FRAME AND COVER DETAILS

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY: Jarrod D. Milligan, PE, Wastewater Engineer, CITY OF TUSCALOOSA	PAGE NO. SD - 070
DRAWN BY:	FES		
DATE:	2011.01.05		
SCALE:	NOT TO SCALE		

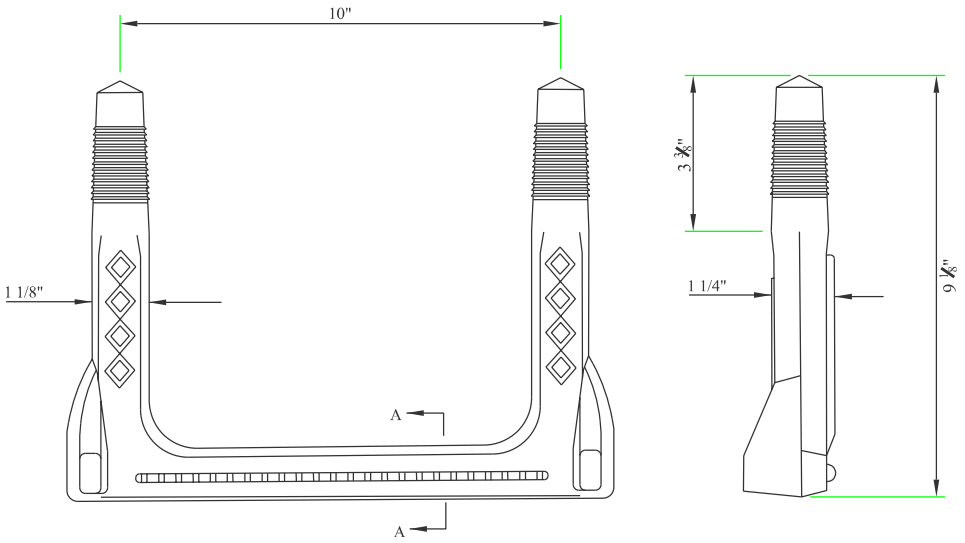

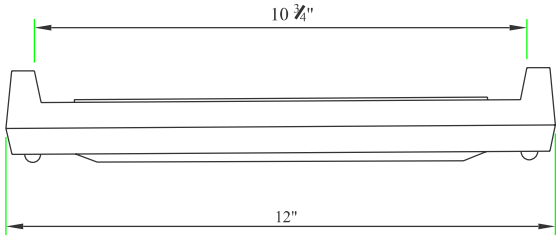



SECTION A

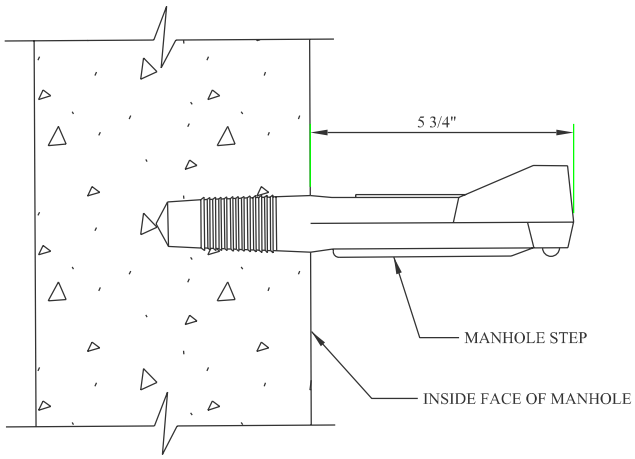

NOTES:

1. MANHOLE AND INLET STEPS SHALL BE PLASTIC COATED REINFORCED STEEL. PLASTIC COATED MANHOLE STEPS SHALL BE POLYPROPYLENE COATED STEEL REINFORCING RODS WITH ROD AND PULL OUT RATINGS MEETING OSHA STANDARDS.
2. MANHOLE AND INLET STEPS SHALL BE INSTALLED AT MAXIMUM 16" INTERVALS

CITY OF TUSCALOOSA

MANHOLE STEP DETAILS

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	*DESCRIPTION*	*BY*

FILE NAME:		*APPROVED BY:*	*PAGE NO.*
DRAWN BY:	*FES*	*Jarrod D. Milligan, PE*	SD - 075
DATE:	*2011.01.05*	*Wastewater Engineer*	
SCALE:	*NOT TO SCALE*	*CITY OF TUSCALOOSA*	

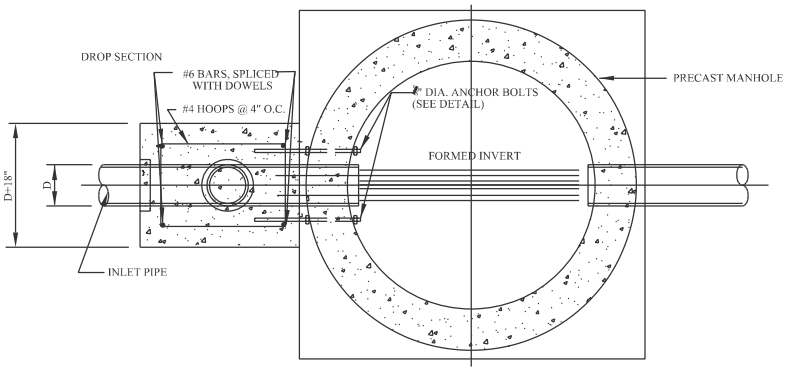

SECTIONAL PLAN

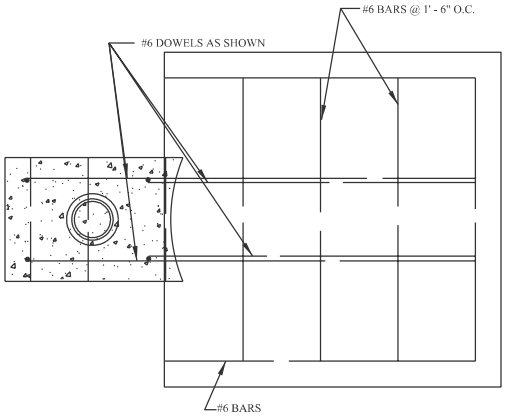

SLAB SECTION

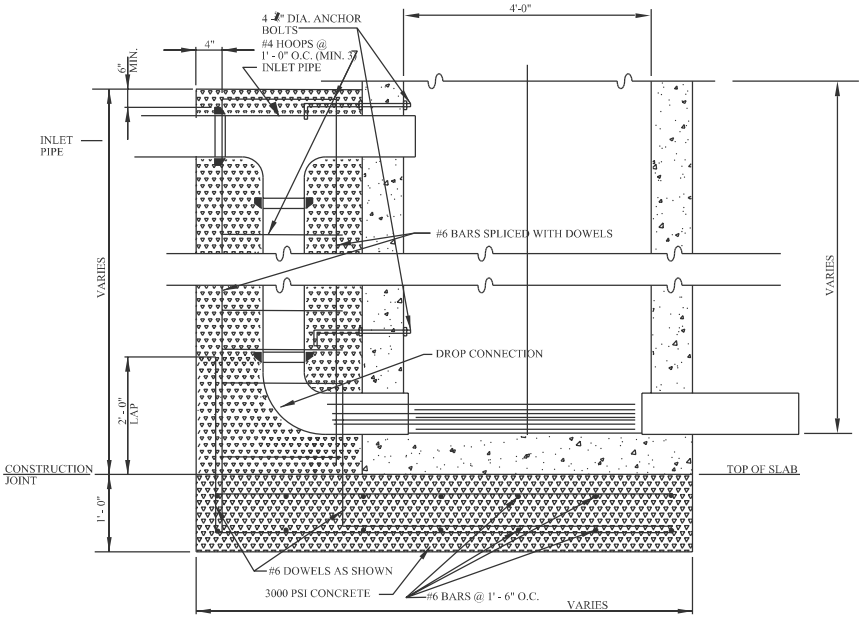

SECTIONAL ELEVATION

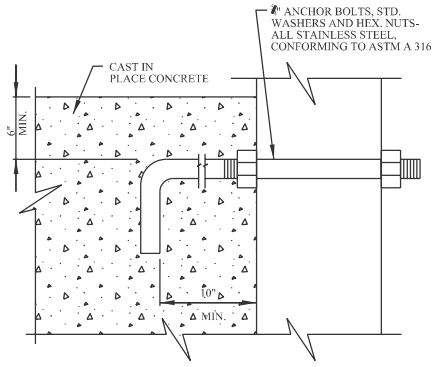

ANCHOR BOLT DETAIL

NOTES:

1. ALL BASES TO BE POURED MONOLITHICALLY.
2. PROVIDE 3" OF CLEAR CONCRETE COVER TO ALL REINFORCING BARS UNLESS OTHERWISE NOTED.
3. ALL CAST-IN-PLACE CONCRETE SHALL BE CLASS "A".

TYPICAL MEMPHIS TEE

NO SCALE

CITY OF TUSCALOOSA

MEMPHIS TEE AND ANCHOR BOLT DETAIL

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY: Jarrod D. Milligan, PE, Wastewater Engineer, CITY OF TUSCALOOSA	PAGE NO. SD - 080
DRAWN BY:	FES		
DATE:	2011.01.05		
SCALE:	NOT TO SCALE		

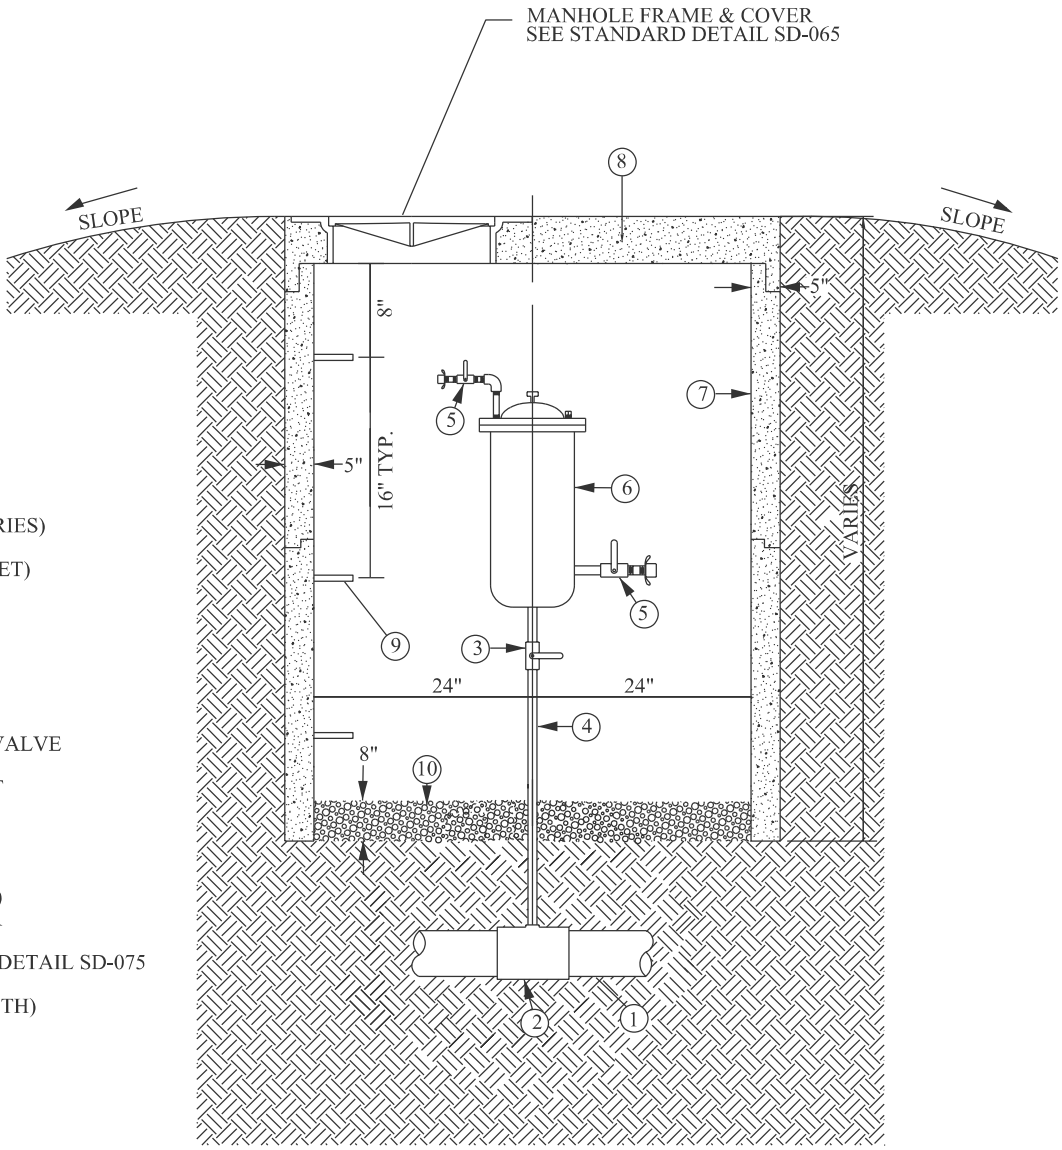

MATERIAL IDENTIFICATION

1. PRESSURE SEWER MAIN (SIZE VARIES)
2. THREADED TEE (SIZE TO SUIT INLET)
3. 2" SHUT OFF BRASS BALL VALVE
4. 2" THREADED BRASS NIPPLE
5. 1" BLOW OFF BRASS BALL VALVE
6. SEWAGE AIR/VACUUM RELEASE VALVE
7. STANDARD 4' DIAMETER PRECAST CONCRETE DOGHOUSE MANHOLE OR MANHOLE TOP SECTION, AS DIRECTED BY THE ENGINEER
8. PRECAST CONCRETE FLAT TOP (6") WITH MANHOLE RING AND COVER
9. MANHOLE STEPS, SEE STANDARD DETAIL SD-075
10. CRUSHED LIMESTONE (8" MIN. DEPTH)

AUTOMATIC VAC/AIR RELEASE VALVE DETAIL

NO SCALE

CITY OF TUSCALOOSA

AIR/VACUUM RELEASE VALVE MANHOLE DETAIL

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:	
DRAWN BY:	FES
DATE:	2011.01.05
SCALE:	NOT TO SCALE

APPROVED BY:
Jarrod D. Milligan, PE
Wastewater Engineer
CITY OF TUSCALOOSA

PAGE NO.
SD - 085

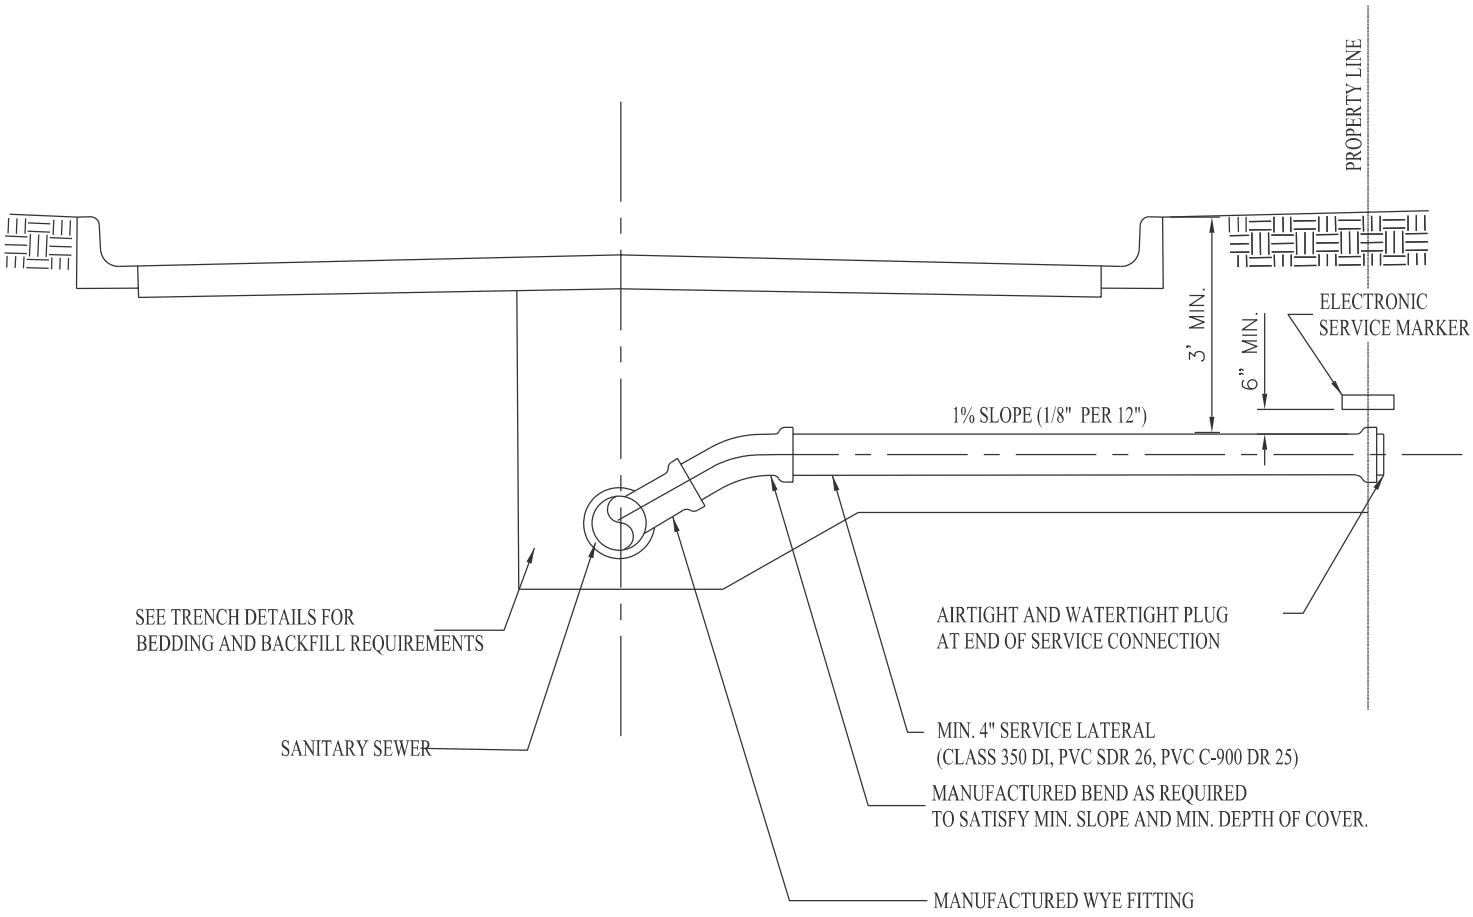

NOTES:

1. SERVICE LATERALS SHALL BE INSTALLED FOR EACH LOT AND EXTEND TO USER'S PROPERTY LINE.
2. MINIMUM DEPTH OF COVER FROM TOP OF CURB SHALL BE 3 FEET.
3. METALLIC TAPE OR WIRE SHALL BE INSTALLED ABOVE PVC SERVICE LATERALS.

CITY OF TUSCALOOSA

SERVICE LATERAL CONNECTION SHALLOW SEWER

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	*DESCRIPTION*	*BY*

FILE NAME:		*APPROVED BY:*	*PAGE NO.*
DRAWN BY:	*FES*	*Jarrod D. Milligan, PE*	SD - 090
DATE:	*2011.01.05*	*Wastewater Engineer*	
SCALE:	*NOT TO SCALE*	*CITY OF TUSCALOOSA*	

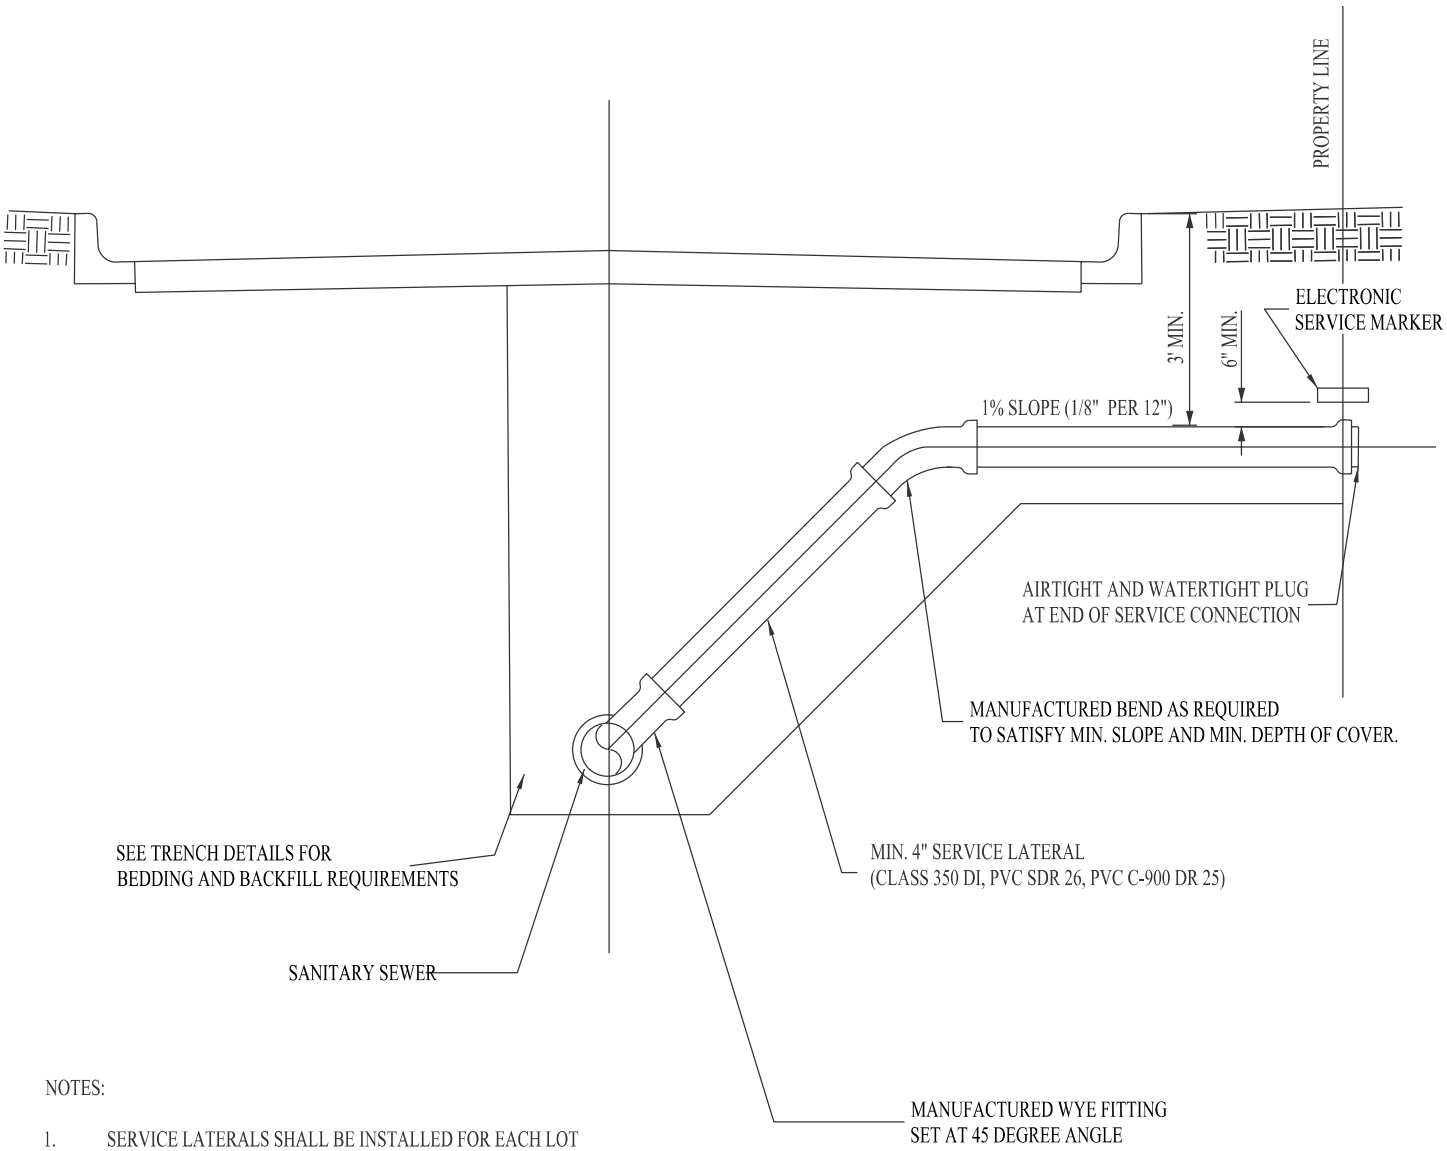

NOTES:

1. SERVICE LATERALS SHALL BE INSTALLED FOR EACH LOT AND EXTEND TO USER'S PROPERTY LINE.
2. MINIMUM DEPTH OF COVER FROM TOP OF CURB SHALL BE 3 FEET.
3. METALLIC TAPE OR WIRE SHALL BE INSTALLED ABOVE PVC SERVICE LATERALS.

CITY OF TUSCALOOSA

SERVICE LATERAL CONNECTION DEEP SEWER

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	*DESCRIPTION*	*BY*

FILE NAME:		*APPROVED BY:*	*PAGE NO.*
DRAWN BY:	*FES*	*Jarrod D. Milligan, PE*	SD - 095
DATE:	*2011.01.05*	*Wastewater Engineer*	
SCALE:	*NOT TO SCALE*	*CITY OF TUSCALOOSA*	

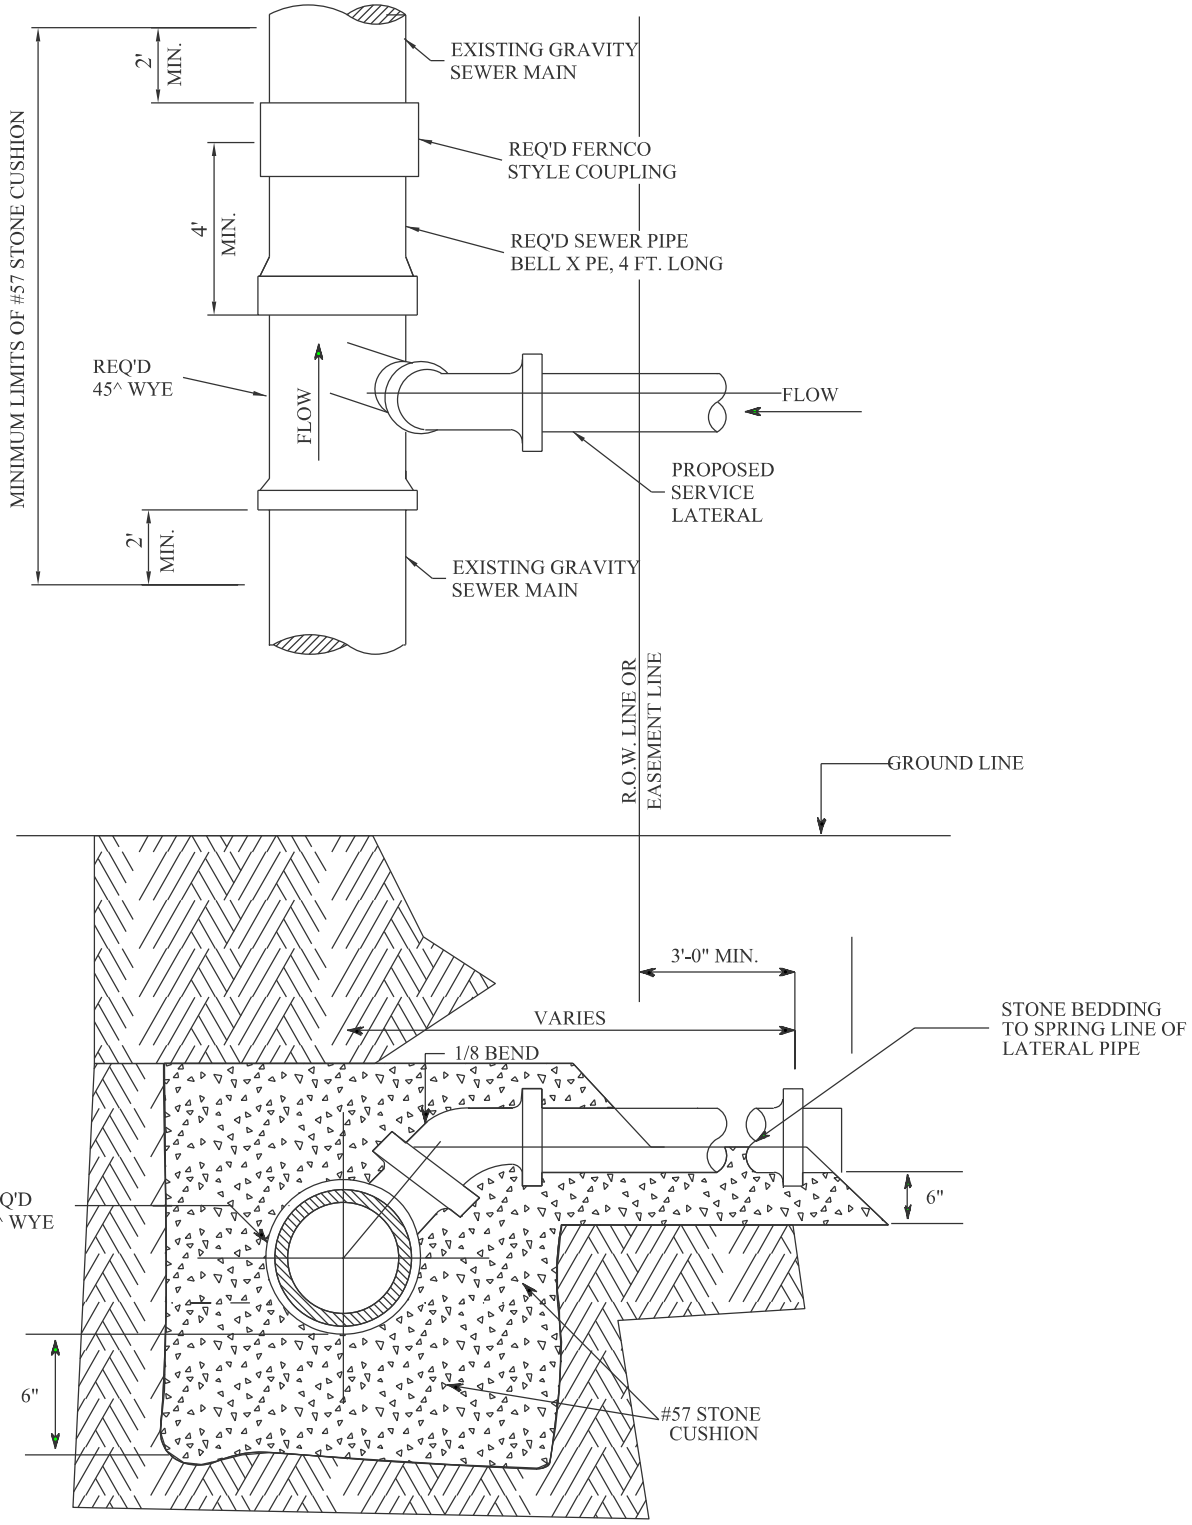

SERVICE LATERAL CONNECTION TO EXISTING GRAVITY SEWER

WASTEWATER ENGINEERING STANDARD DETAILS

CITY OF TUSCALOOSA

REVISION		
DATE	DESCRIPTION	BY

FILE NAME:	
DRAWN BY:	FES
DATE:	2011.01.05
SCALE:	NOT TO SCALE

APPROVED BY:
Jarrod D. Milligan, PE
Wastewater Engineer
CITY OF TUSCALOOSA

PAGE NO.
SD - 096

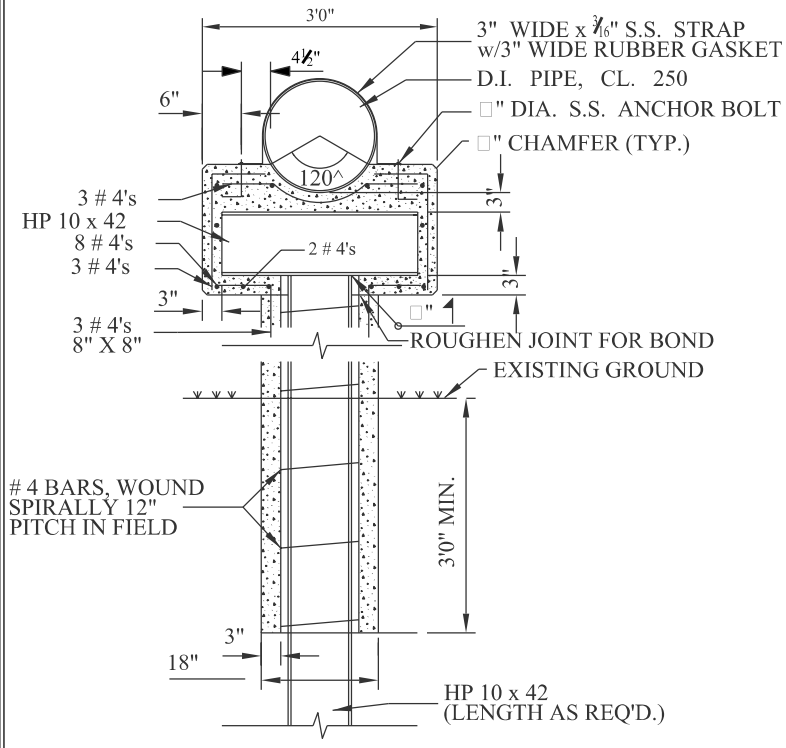

TYPICAL SECTION - FRONT VIEW

NO SCALE

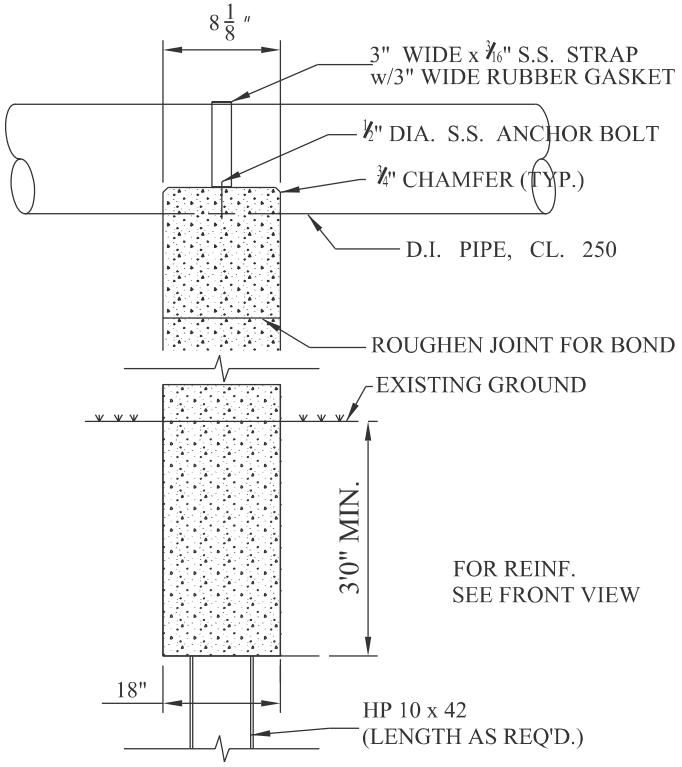

TYPICAL SECTION - SIDE VIEW

NO SCALE

GENERAL NOTE:

1) H PILES SHALL BE FITTED WITH PILE POINTS.

2) H PILES SHALL BE DRIVEN TO SOUND SHALE ROCK. EXACT LINEAR FOOTAGE TO BE DETERMINED IN THE FIELD. LINEAR FOOT PRICE FOR H PILES SHALL INCLUDE REINFORCED CONCRETE WRAP FROM 3'-0" BELOW EXISTING GROUND TO THE SEAT OF THE HORIZONTAL H PILE.

3) ELEVATED SEWER PILE CAP SHALL BE PAID FOR PER EACH AND INCLUDE HORIZONTAL H PILE, CONCRETE REINFORCING, CONCRETE, STAINLESS STEEL PIPE STRAP AND ACCESSORIES AND ALL LABOR, MATERIALS AND EQUIPMENT NECESSARY FOR A COMPLETE INSTALLATION.

CITY OF TUSCALOOSA

ELEVATED SANITARY SEWER

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY:	PAGE NO.
DRAWN BY:	FES	Jarrod D. Milligan, PE	SD - 100
DATE:	2011.01.05	Wastewater Engineer	
SCALE:	NOT TO SCALE	CITY OF TUSCALOOSA	

NOTES:

1. ALL CONCRETE SHALL BE PROPORTIONED TO PROVIDE A MINIMUM OF 4000 PSI COMPRESSIVE STRENGTH AT 28 DAYS.

2. REINFORCING STEEL USED IN CONCRETE SHALL CONFORM TO ASTM A 615 INCLUDING SI GRADE 60.

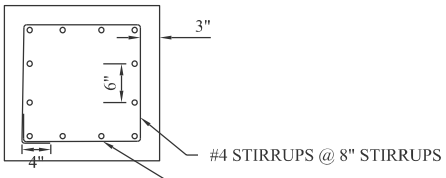

A-A

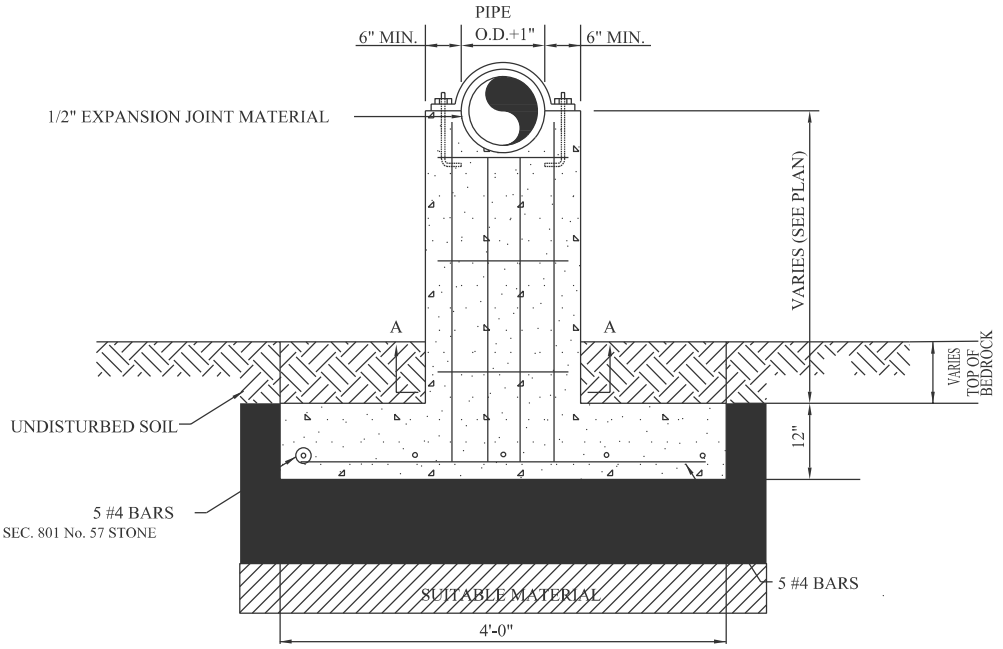

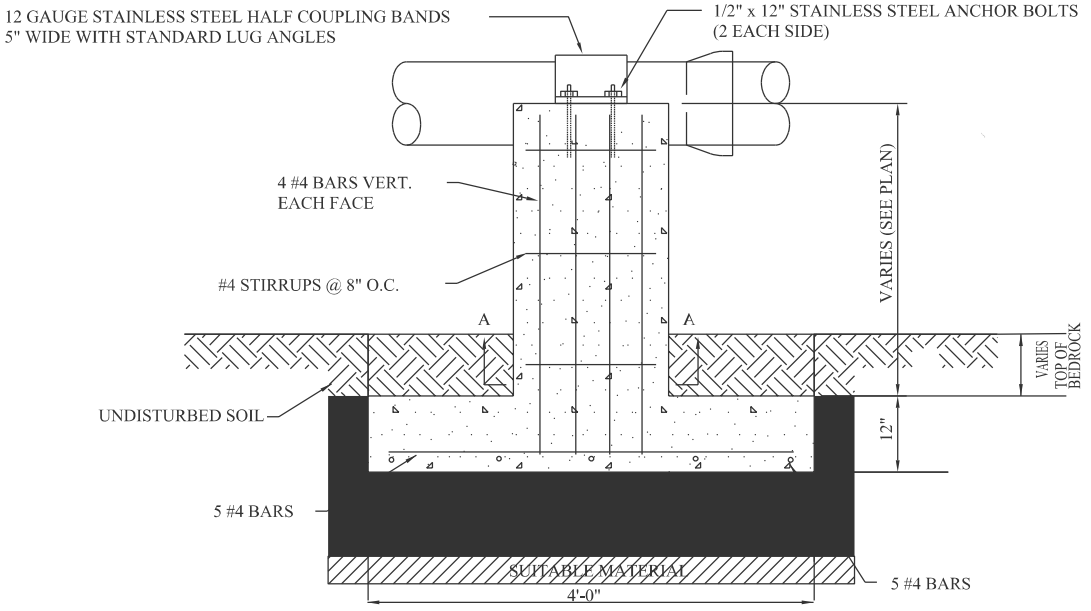

CITY OF TUSCALOOSA

CONCRETE PIER DETAIL

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY: Jarrod D. Milligan, PE, Wastewater Engineer, CITY OF TUSCALOOSA	PAGE NO. SD-101
DRAWN BY:	FES		
DATE:	2011.01.05		
SCALE:	NOT TO SCALE		

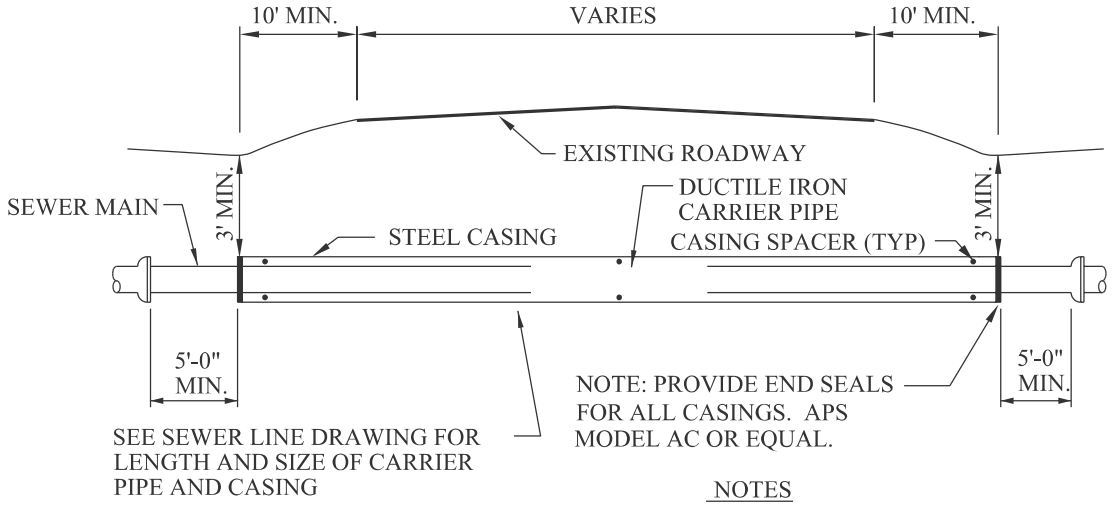

NOTES

1. 3- SPACERS PER JOINT OF PIPE
2. CARRIER PIPE SPACERS SHALL BE MODEL B-55 AS MANUFACTURED BY CONTRACTORS MANUFACTURING INC. OR EQUAL

TYPICAL ROAD BORE DETAIL

NO SCALE

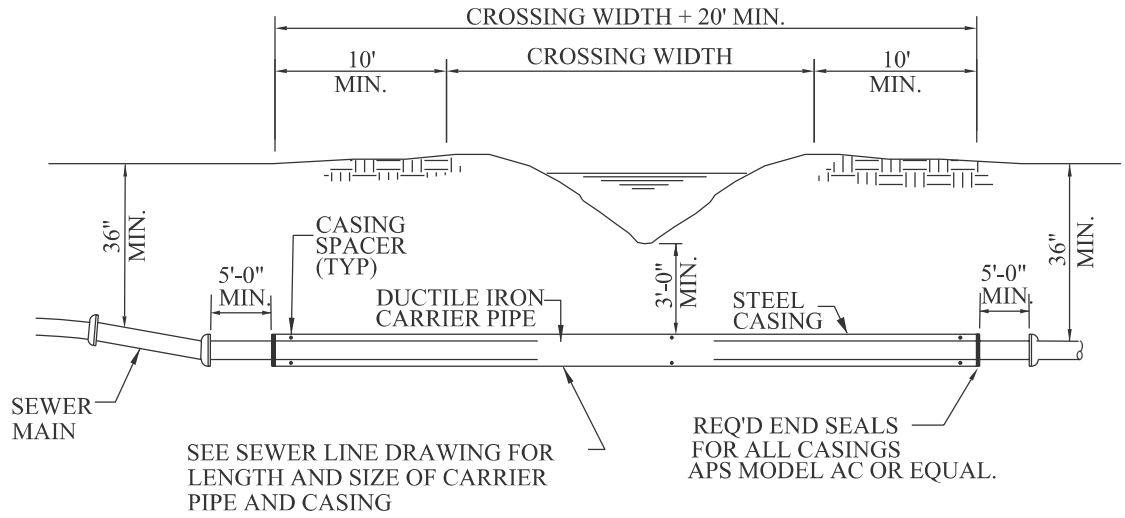

TYPICAL WET DITCH/CREEK CROSSING

NO SCALE

NOTES

1. 3- SPACERS PER JOINT OF PIPE
2. CARRIER PIPE SPACERS SHALL BE MODEL B-55 AS MANUFACTURED BY CONTRACTORS MANUFACTURING INC. OR EQUAL

CITY OF TUSCALOOSA

TYPICAL WET DITCH/CREEK CROSSING AND BORE DETAILS

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY:	PAGE NO.
DRAWN BY:	FES	Jarrod D. Milligan, PE	SD - 105
DATE:	2011.01.05	Wastewater Engineer	
SCALE:	NOT TO SCALE	CITY OF TUSCALOOSA	

THRUST BLOCKING FOR HORIZONTAL BENDS

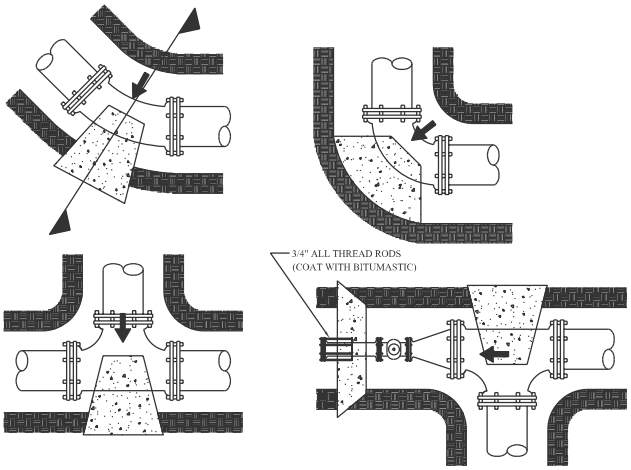

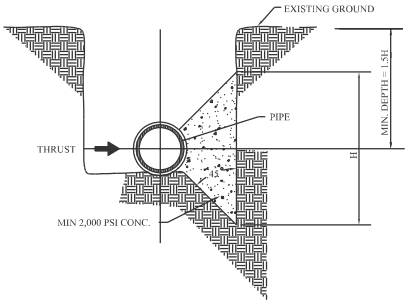

TYP. SECTION @ THRUST BLOCK
NO SCALE

PIPE DIA. (IN.)	MINIMUM BEARING AREA OF THRUST BLOCKS FOR HORIZONTAL BENDS (SQ. FT.)				
	TEE, WYE PLUG, CAP	90 DEG. BEND PLUGGED CROSS	45 DEG. BEND	22 1/2 DEG. BEND	11 1/4 DEG. BEND
4	1.3	2.0	1.0	––	––
6	2.8	4.0	2.0	1.0	––
8	4.8	6.8	3.7	1.9	1.0
10	7.3	10.3	5.5	2.8	1.4
12	10.3	14.5	7.8	4.0	2.0
14	13.8	19.5	10.6	5.4	2.7
16	17.8	25.2	13.6	6.9	3.5
18	22.4	31.7	17.1	8.7	4.4
20	27.5	38.9	21.0	10.7	5.4
24	39.2	55.4	30.0	15.3	7.7
30	60.3	85.3	46.2	23.5	11.8
36	86.4	122.2	66.1	33.7	16.9
42	116.6	164.9	89.3	45.5	22.8
48	152.0	214.9	116.3	59.3	29.7
54	192.0	271.6	147.0	74.9	37.6

THRUST BLOCKING FOR VERTICAL BENDS

FITTING SIZE	MINIMUM VOLUME OF THRUST BLOCK IN CUBIC YARDS (VERTICAL BENDS) BEND ANGLE		
	45 DEGREE	22 1/2 DEGREE	11 1/4 DEGREE
4	1.1	0.4	0.2
6	2.7	1.0	0.4
8	4.0	1.5	0.7
10	6.0	2.3	0.9
12	8.5	3.2	1.3
14	11.5	4.3	1.8
16	14.8	5.6	2.3

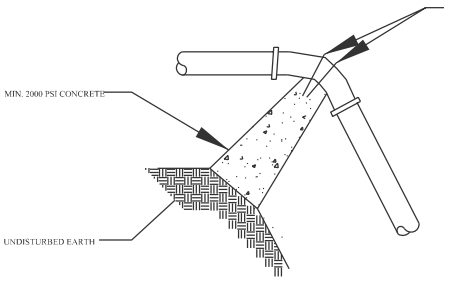

FITTING SIZE	ROD SIZE	EMBEDMENT
12"andless	#6	30"
14" - 16"	#8	36"

GENERAL NOTES FOR HORIZONTAL AND VERTICAL BLOCKING

1. ALL PRESSURE PIPE 4 INCHES IN DIAMETER AND LARGER SHALL BE PROVIDED WITH CONCRETE THRUST RESTRAINT.
2. THRUST BLOCKING SHALL BE POURED AGAINST UNDISTURBED EARTH.
3. CONCRETE SHALL BE KEPT CLEAR OF JOINT AND JOINT ACCESSORIES.
4. BEARING AREA OF THRUST BLOCKS ARE BASED ON 150 PSI TEST PRESSURE AND AN ALLOWABLE SOIL BEARING OF 2000 PSF. BEARING AREA VALUES SHALL BE ADJUSTED IF THE SPECIFICATIONS REQUIRE A DIFFERENT TEST PRESSURE OR ALLOWABLE SOIL BEARING. PROVIDE ADDITIONAL AREA IF DICTATED BY THE CONDITIONS ACTUALLY ENCOUNTERED.
5. ANY SPECIAL THRUST BLOCKING DETAILED ON THE PLANS SHALL SUPERCEDE THIS DETAIL.
6. VERTICAL BENDS THAT REQUIRE A THRUST BLOCK VOLUME GREATER THAN 5 C.Y. REQUIRE SPECIAL BLOCKING DETAILS.

CITY OF TUSCALOOSA

THRUST RESTRAINT - CONCRETE BLOCKING

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:	
DRAWN BY:	FES
DATE:	2011.01.05
SCALE:	NOT TO SCALE

APPROVED BY:
Jarrod D. Milligan, PE
Wastewater Engineer
CITY OF TUSCALOOSA

PAGE NO.
SD--110

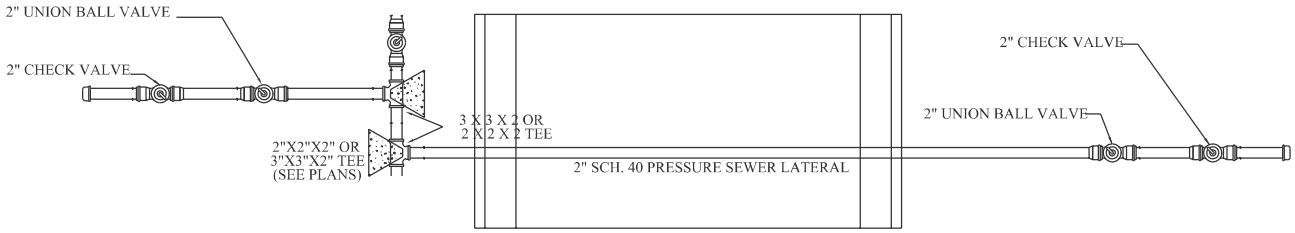

PLAN

N.T.S.

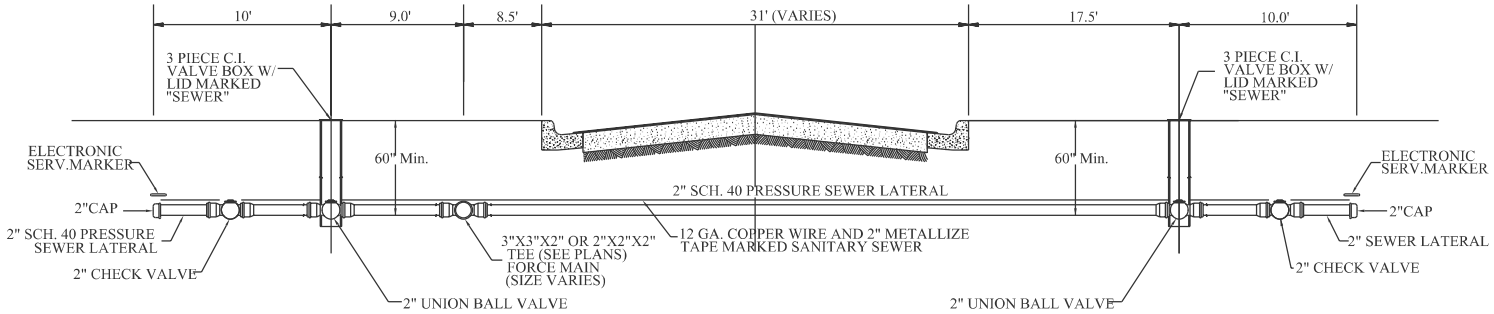

ALL PIPE AND FITTINGS
SHALL BE SCH. SDR 26, SCH. 40 OR 80 P.C.V.

ELEVATION

N.T.S.

CITY OF TUSCALOOSA

LOW PRESSURE SERVICE LATERAL

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY:	PAGE NO.
DRAWN BY:	FES	Jarrod D. Milligan, PE	SD - 120
DATE:	2011.01.05	Wastewater Engineer	
SCALE:	NOT TO SCALE	CITY OF TUSCALOOSA	

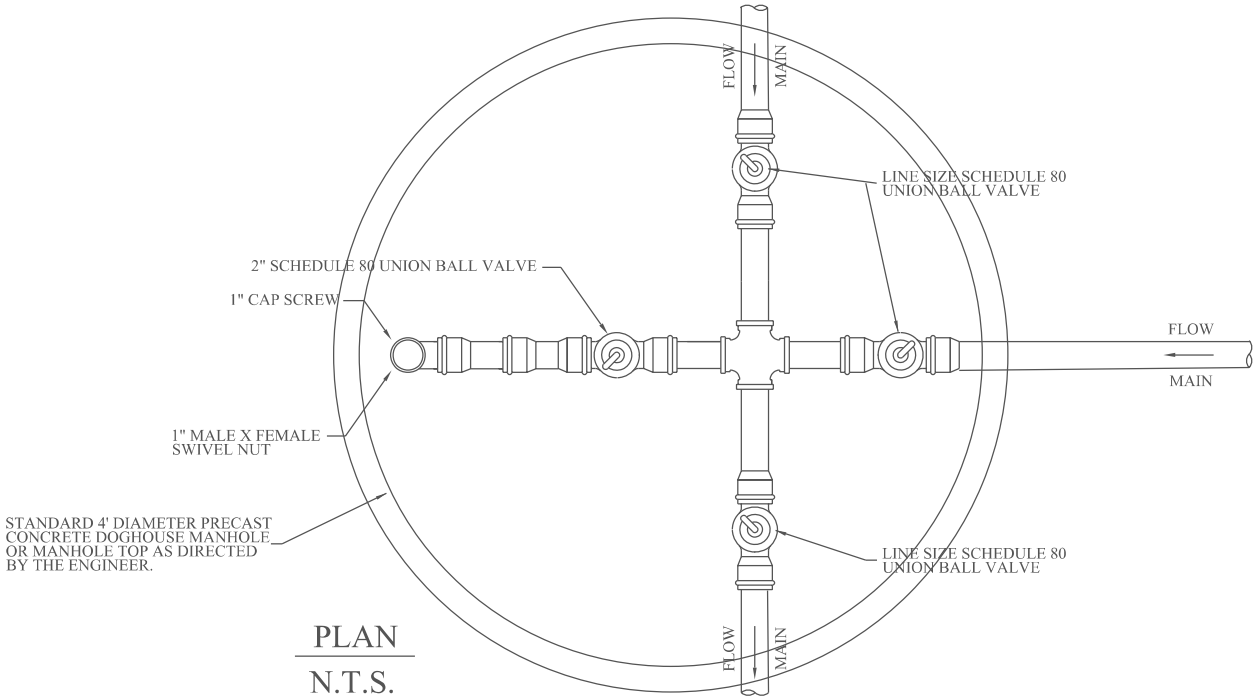

PLAN

N.T.S.

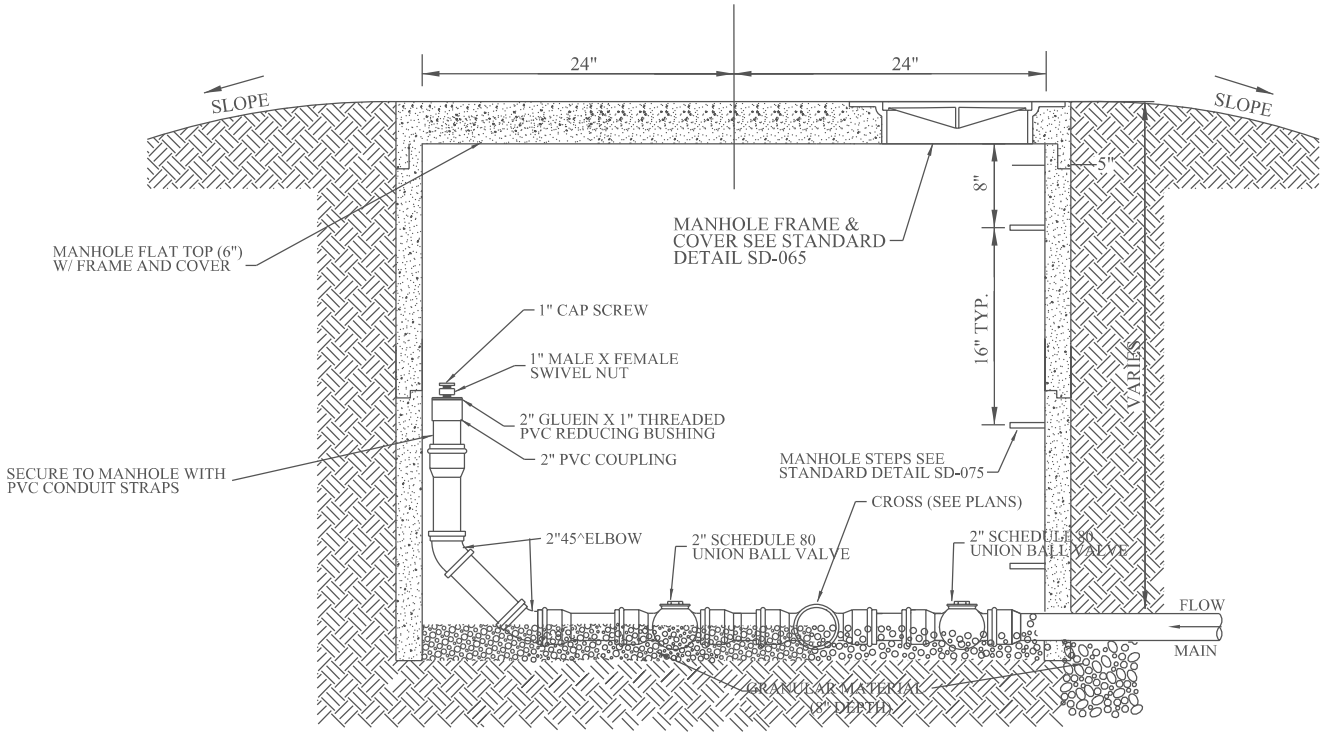

ELEVATION

N.T.S.

ALL PIPE AND FITTINGS
SHALL BE P.V.C. SDR 26, SCH. 40 OR 80

CITY OF TUSCALOOSA

LOW PRESSURE JUNCTION FLUSHING CONNECTION

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:	
DRAWN BY:	FES
DATE:	2011.01.05
SCALE:	NOT TO SCALE

APPROVED BY:
Jarrod D. Milligan, PE
Wastewater Engineer
CITY OF TUSCALOOSA

PAGE NO.
SD - 125

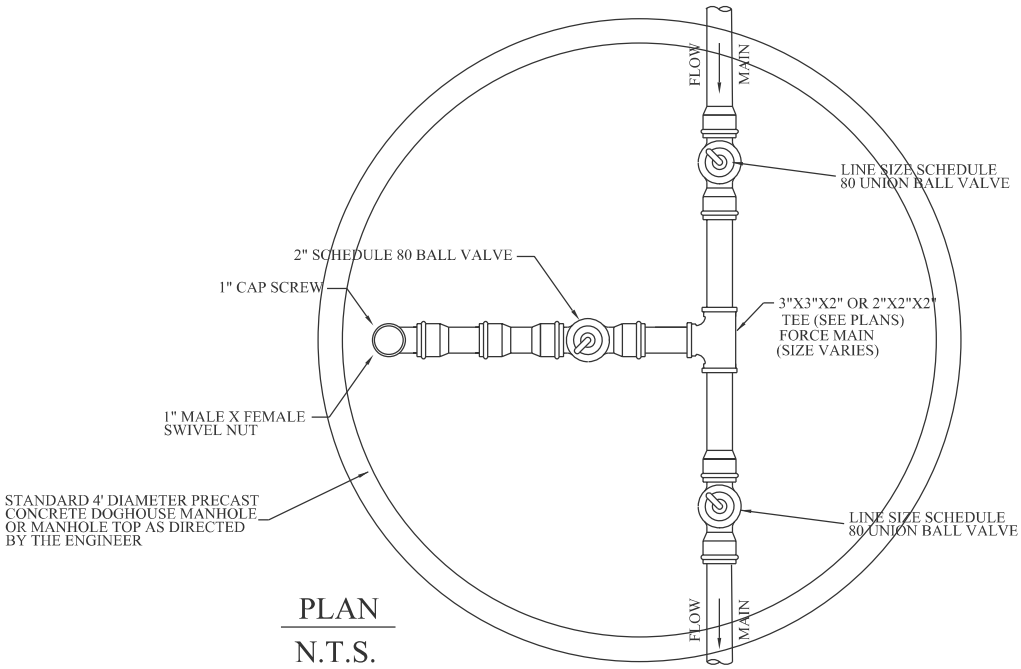

PLAN

N.T.S.

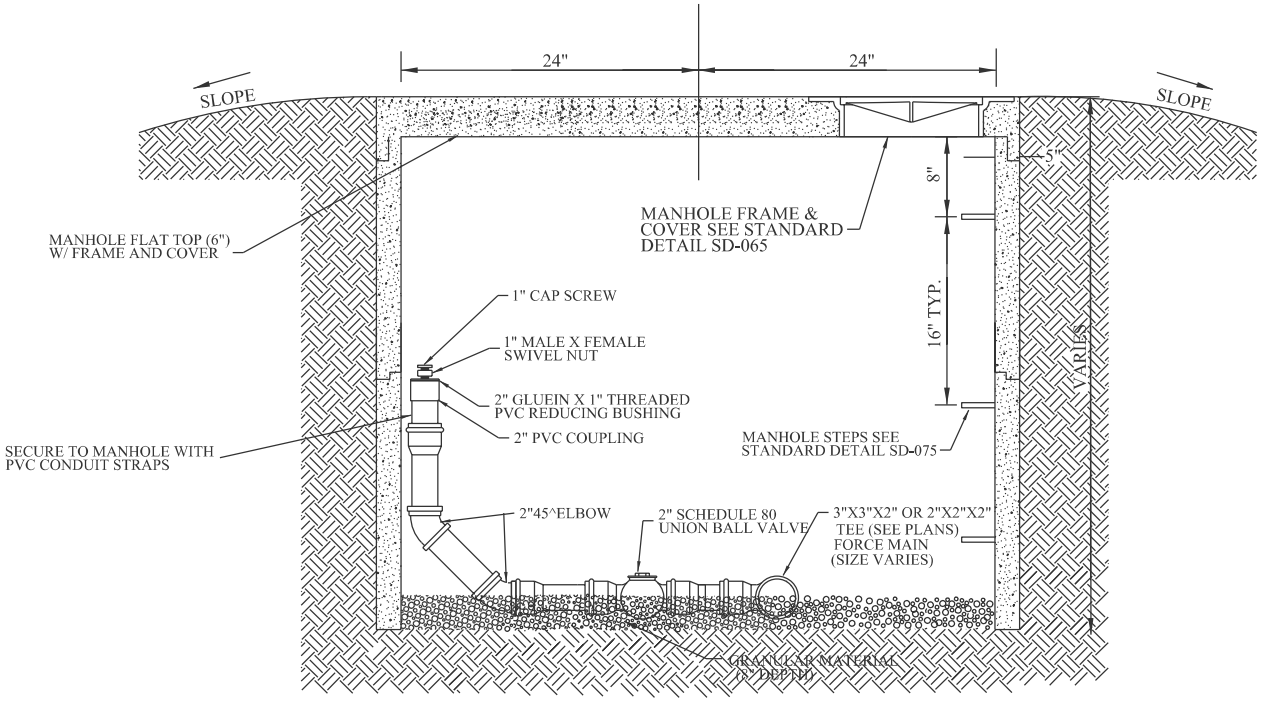

ELEVATION

N.T.S.

ALL PIPE AND FITTINGS
SHALL BE P.V.C. SDR 26, SCH. 40 OR 80

CITY OF TUSCALOOSA

LOW PRESSURE INTERMEDIATE FLUSHING CONNECTION (A)

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY: Jarrod D. Milligan, PE, Wastewater Engineer, CITY OF TUSCALOOSA	PAGE NO. SD - 130
DRAWN BY:	FES		
DATE:	2011.01.05		
SCALE:	NOT TO SCALE		

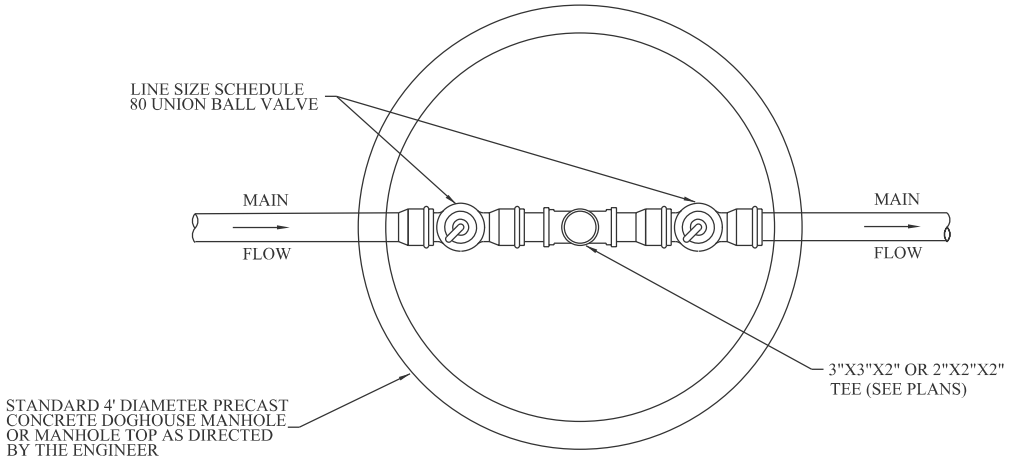

PLAN

N.T.S.

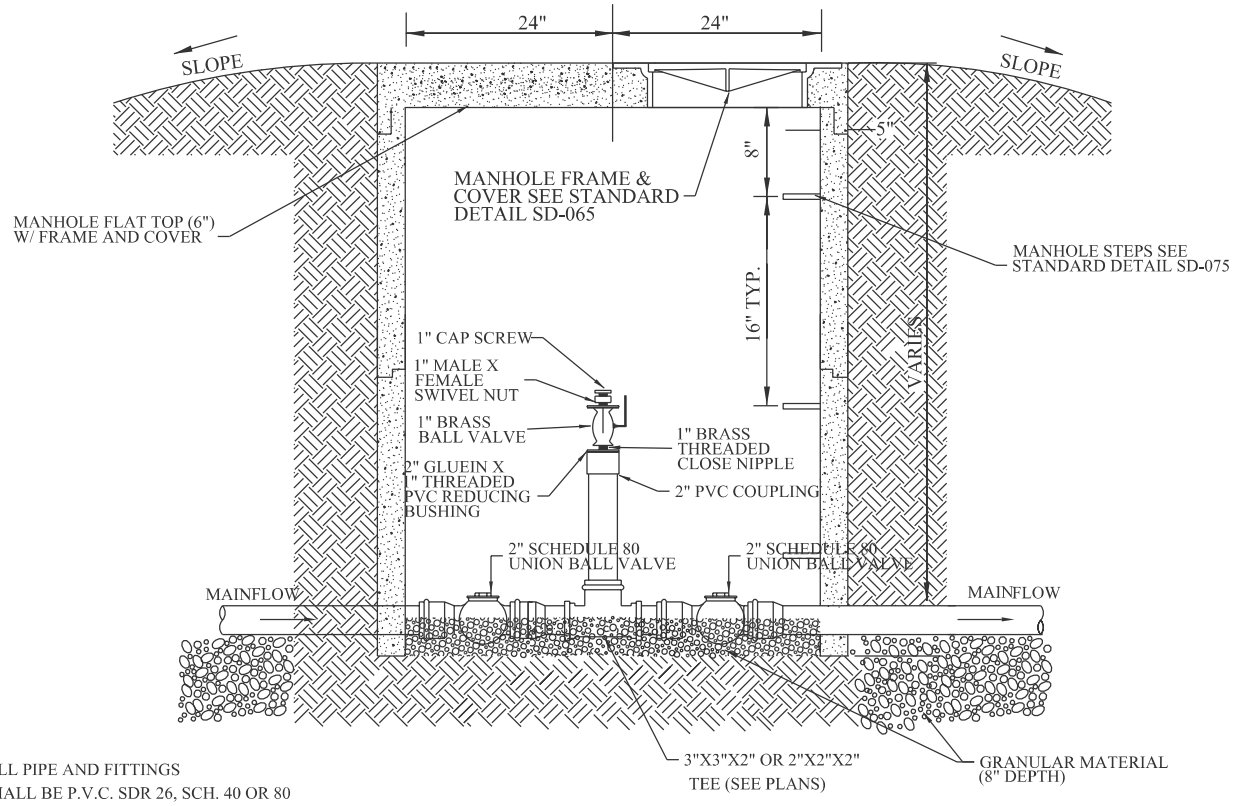

ALL PIPE AND FITTINGS
SHALL BE P.V.C. SDR 26, SCH. 40 OR 80

ELEVATION

N.T.S.

CITY OF TUSCALOOSA

LOW PRESSURE INTERMEDIATE FLUSHING CONNECTION (B)

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION		
DATE	*DESCRIPTION*	*BY*

FILE NAME:		*APPROVED BY:*	*PAGE NO.*
DRAWN BY:	*FES*	*Jarrod D. Milligan, PE*	SD - 131
DATE:	*2011.01.05*	*Wastewater Engineer*	
SCALE:	*NOT TO SCALE*	*CITY OF TUSCALOOSA*	

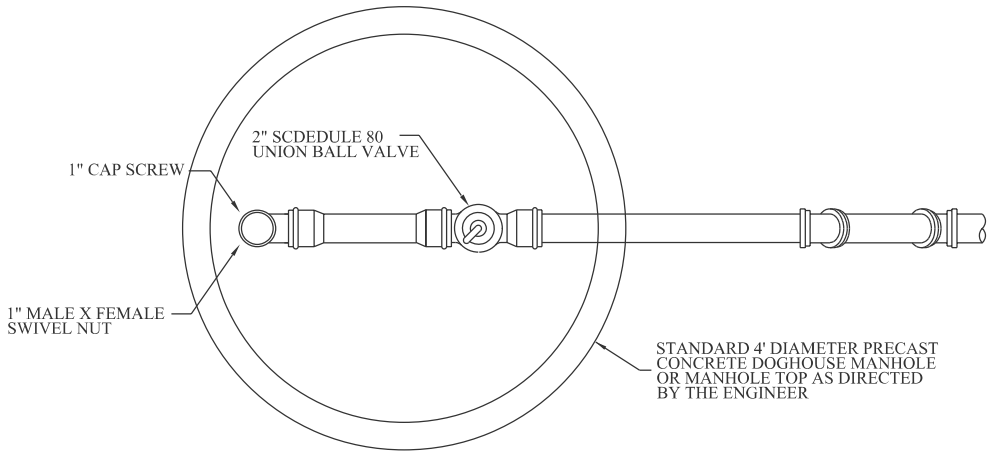

PLAN

N.T.S.

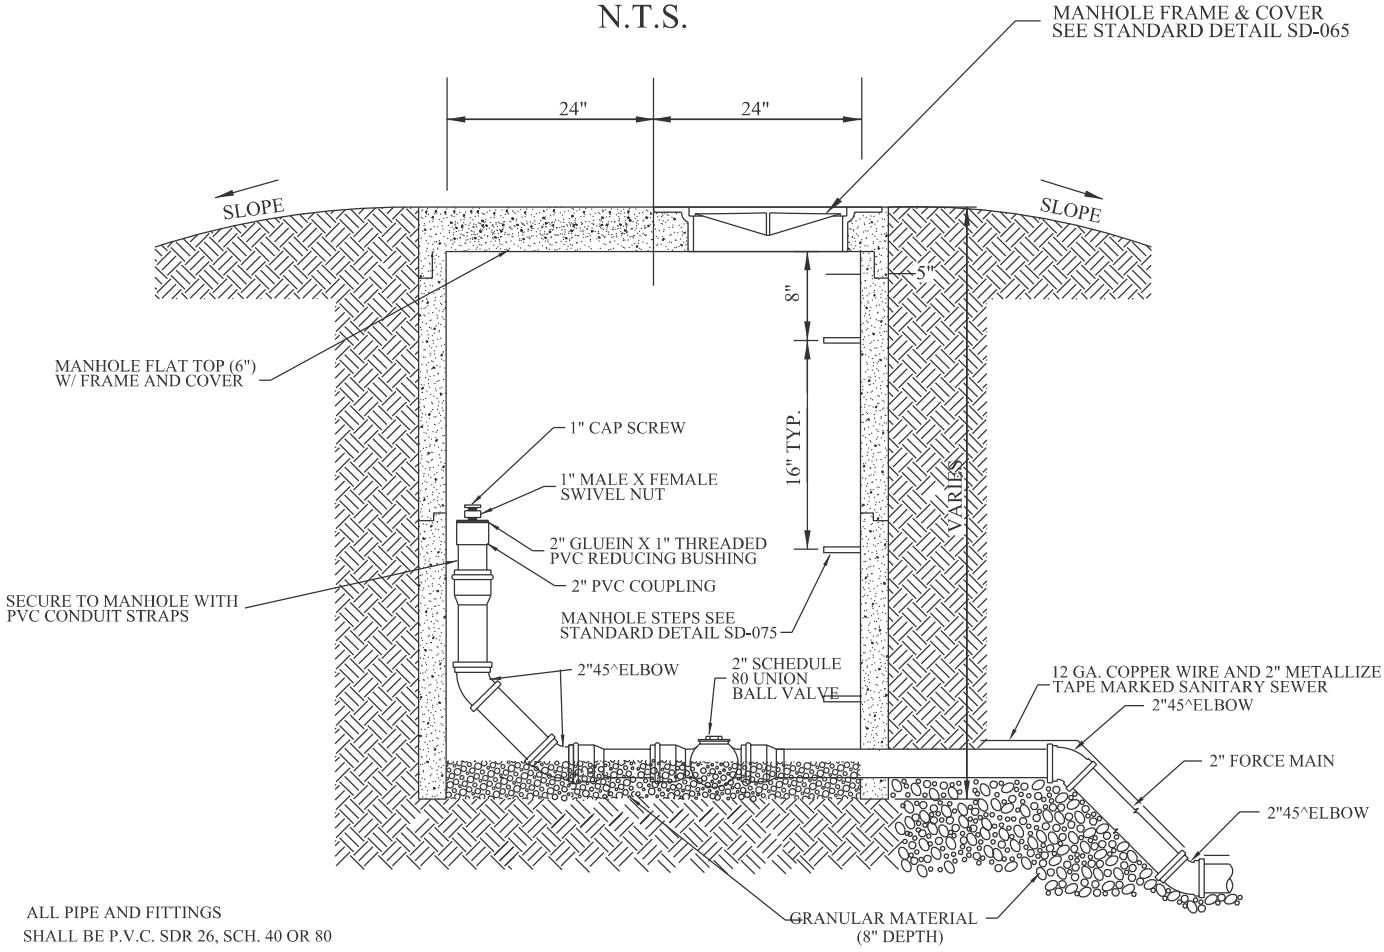

ELEVATION

N.T.S.

CITY OF TUSCALOOSA

LOW PRESSURE TERMINAL FLUSHING CONNECTION

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY:	PAGE NO.
DRAWN BY:	FES	Jarrod D. Milligan, PE	SD - 135
DATE:	2011.01.05	Wastewater Engineer	
SCALE:	NOT TO SCALE	CITY OF TUSCALOOSA	

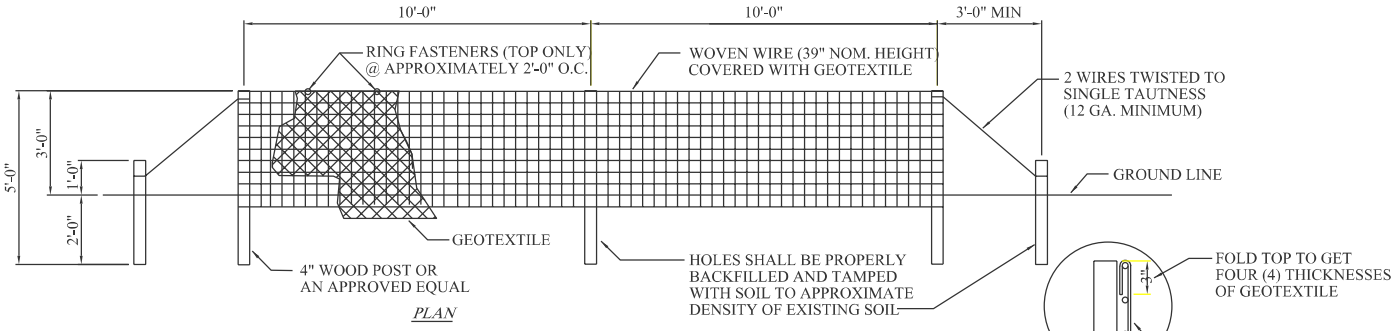

SILT FENCE - TYPE "A"

NOT TO SCALE

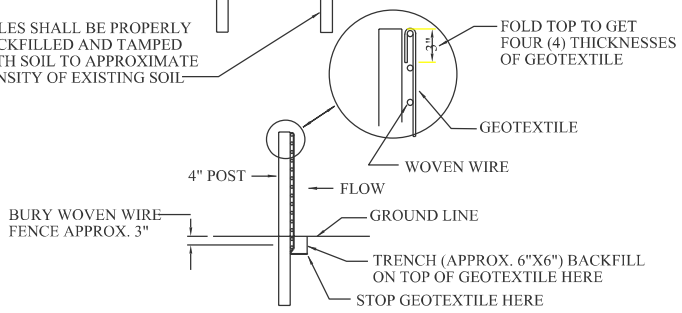

SECTION (METHOD I)

NOTES:

1. SILT FENCES ARE TEMPORARY EROSION CONTROL ITEMS, THAT SHALL BE ERECTED OPPOSITE ERODABLE AREAS SUCH AS NEWLY GRADED FILL SLOPES AND ADJACENT TO STREAMS AND CHANNELS.
2. SILT FENCE SHOULD BE PLACED WELL INSIDE RIGHT OF WAY AND ALONG EDGE OF CLEARING LIMITS, THIS WILL ALLOW ROOM FOR A BACK UP FENCE IF FIRST BECOMES FULL. SILT FENCES SHALL BE IN PLACE PRIOR TO ANY CONSTRUCTION OPERATION.
3. WHEREVER POSSIBLE SILT FENCES SHALL BE CONSTRUCTED ACROSS A FLAT AREA IN THE SHAPE OF A HORSESHOE. THIS AIDS IN PONDING OF RUNOFF AND FACILITATES SEDIMENTATION.
4. AFTER THE CONSTRUCTION AREA IS STABILIZED AND EROSION ACTIVITY CURTAILED, SILT FENCES SHALL BE REMOVED.
5. RING FASTENERS USED TO SECURE GEOTEXTILES TO WOVEN WIRE SHALL BE 13 GA. (AMERICAN).
6. IF WOOD POSTS ARE USED, STAPLES FOR SECURING WOVEN WIRE TO POSTS SHALL BE (9) GAUGE, GALVANIZED, 1-1/2" LONG, 5 PER POST AT APPROX. 1"-0" O.C.
7. WOVEN WIRE TO BE 12-1/2 GAUGE (MIN.).

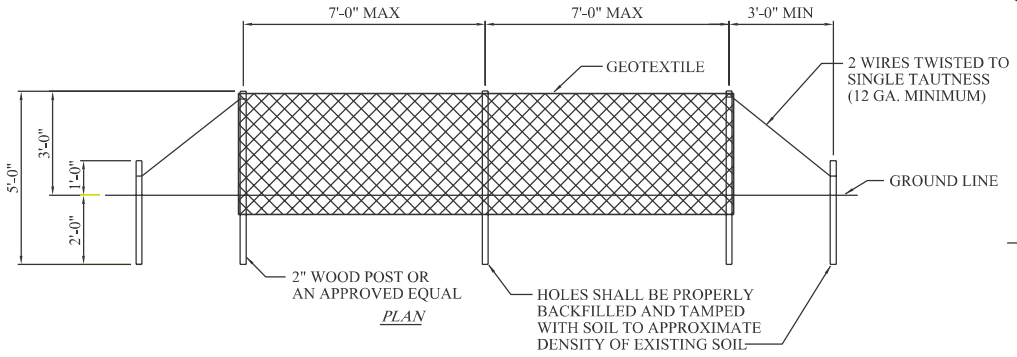

SILT FENCE - TYPE "B"

NOT TO SCALE

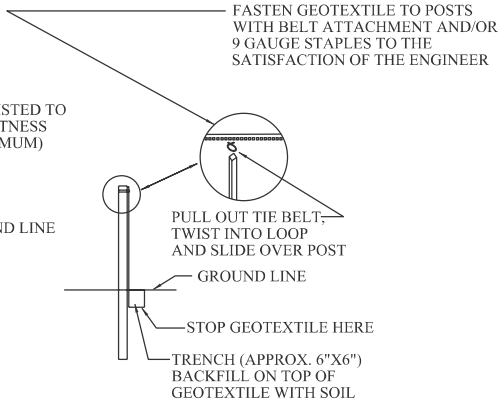

SECTION (METHOD I)

CITY OF TUSCALOOSA

EROSION CONTROL
SILT FENCE - TYPES "A" & "B"

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY: Jarrod D. Milligan, PE, Wastewater Engineer, CITY OF TUSCALOOSA	PAGE NO. SD - 150
DRAWN BY:	FES		
DATE:	2011.01.05		
SCALE:	NOT TO SCALE		

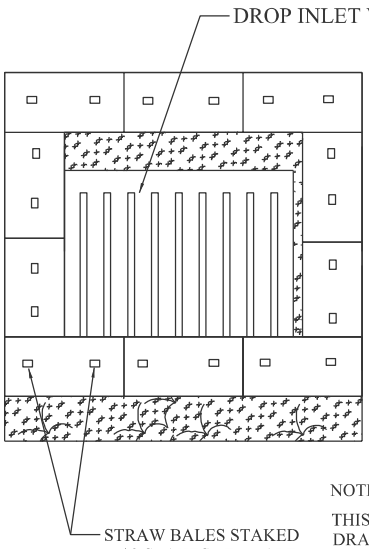

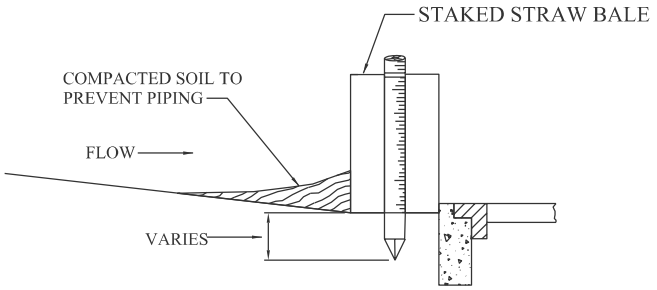

NOTE:

THIS METHOD OF INLET PROTECTION IS APPLICABLE WHERE THE INLET DRAINS A RELATIVELY FLAT AREA (SLOPES NO GREATER THAN 5%) WHERE SHEET OR OVERLAND FLOWS (NOT EXCEEDING 0.5 CFS) ARE TYPICAL. THE METHOD SHALL NOT APPLY TO INLETS RECEIVING CONCENTRATED FLOWS, SUCH AS IN STREETS OR HIGHWAY MEDIANS.

SEDIMENT CONTROL STRUCTURE
STRAW BALE DROP INLET SEDIMENT FILTER

NOT TO SCALE

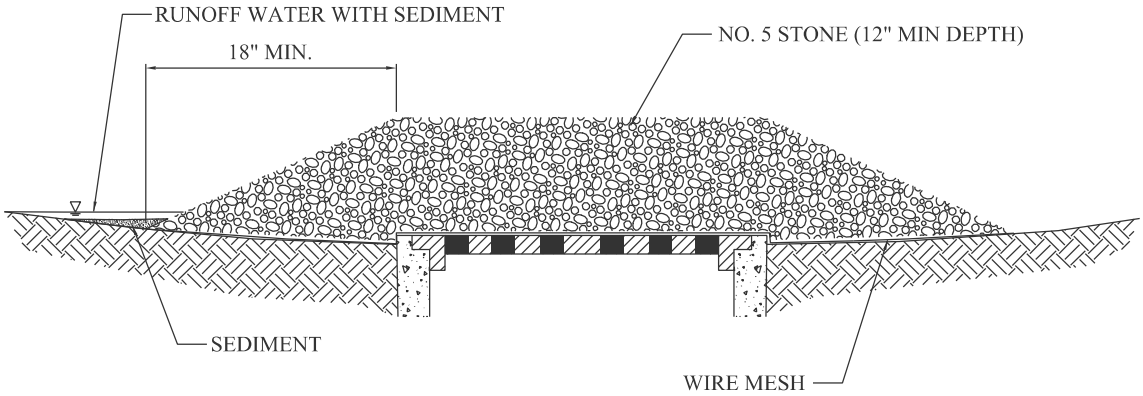

NOTE:

THIS METHOD OF INLET PROTECTION IS APPLICABLE WHERE HEAVY CONCENTRATED FLOWS ARE EXPECTED, BUT NOT WHERE PONDING AROUND THE STRUCTURE MIGHT CAUSE EXCESSIVE INCONVENIENCE OR DAMAGE TO ADJACENT STRUCTURES AND UNPROTECTED AREAS.

SEDIMENT CONTROL STRUCTURE
GRAVEL AND WIRE MESH DROP INLET FILTER

NOT TO SCALE

CITY OF TUSCALOOSA

EROSION CONTROL
DROP INLET SEDIMENT FILTERS

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	*DESCRIPTION*	*BY*

FILE NAME:		*APPROVED BY:*	*PAGE NO.*
DRAWN BY:	*FES*	*Jarrod D. Milligan, PE*	SD - 155
DATE:	*2011.01.05*	*Wastewater Engineer*	
SCALE:	*NOT TO SCALE*	*CITY OF TUSCALOOSA*	

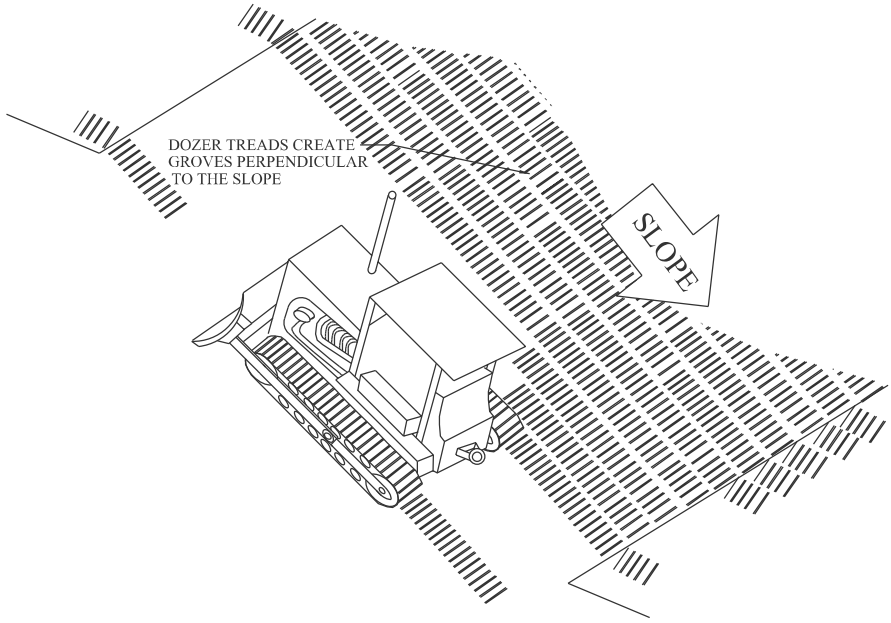

SURFACE ROUGHENING

NOT TO SCALE

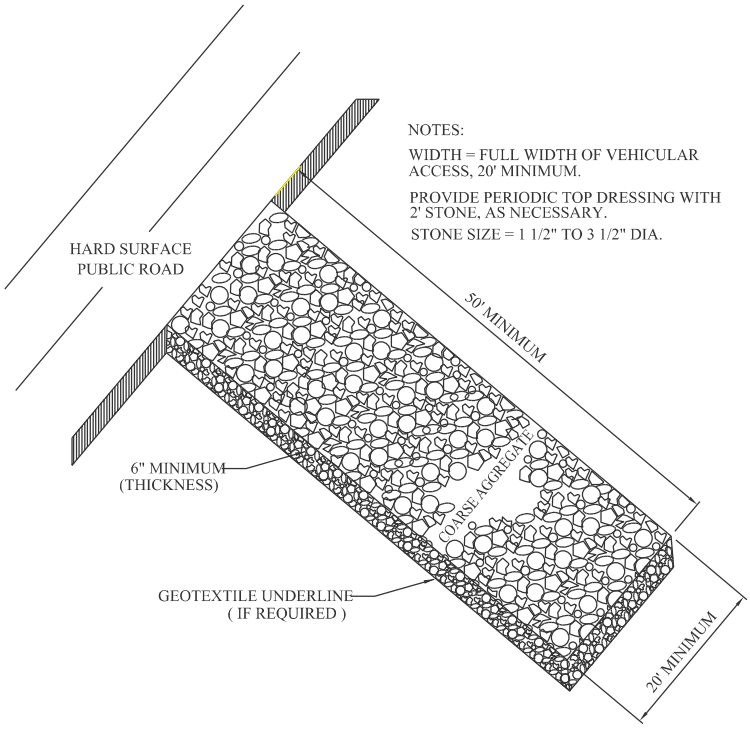

STONE PAD CONSTRUCTION EXIT

NOT TO SCALE

CITY OF TUSCALOOSA

EROSION CONTROL
SURFACE ROUGHENING AND STONE PAD

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	DESCRIPTION	BY

FILE NAME:		APPROVED BY:	PAGE NO.
DRAWN BY:	FES	Jarrod D. Milligan, PE	SD - 160
DATE:	2011.01.05	*Wastewater Engineer*	
SCALE:	NOT TO SCALE	*CITY OF TUSCALOOSA*	

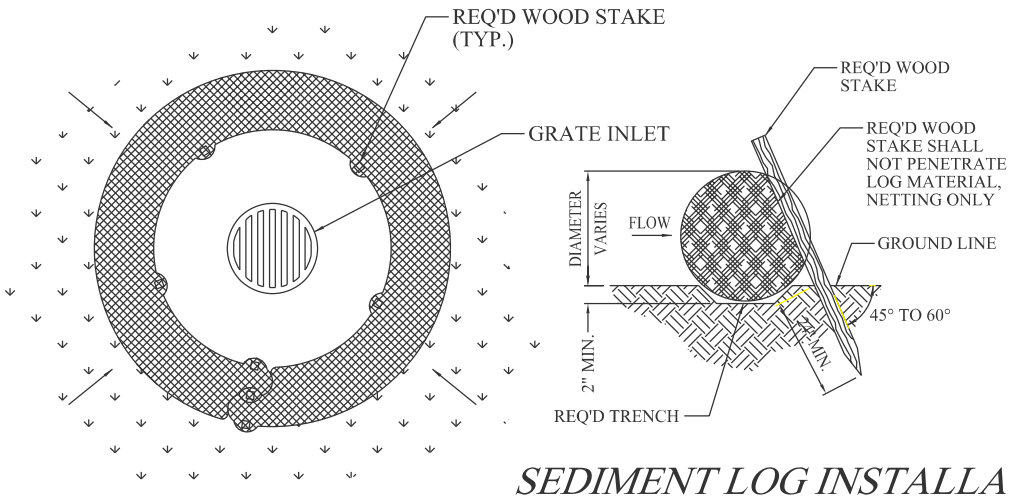

GRATE INLET PROTECTION

NOT TO SCALE

SEDIMENT LOG INSTALLATION

NOT TO SCALE

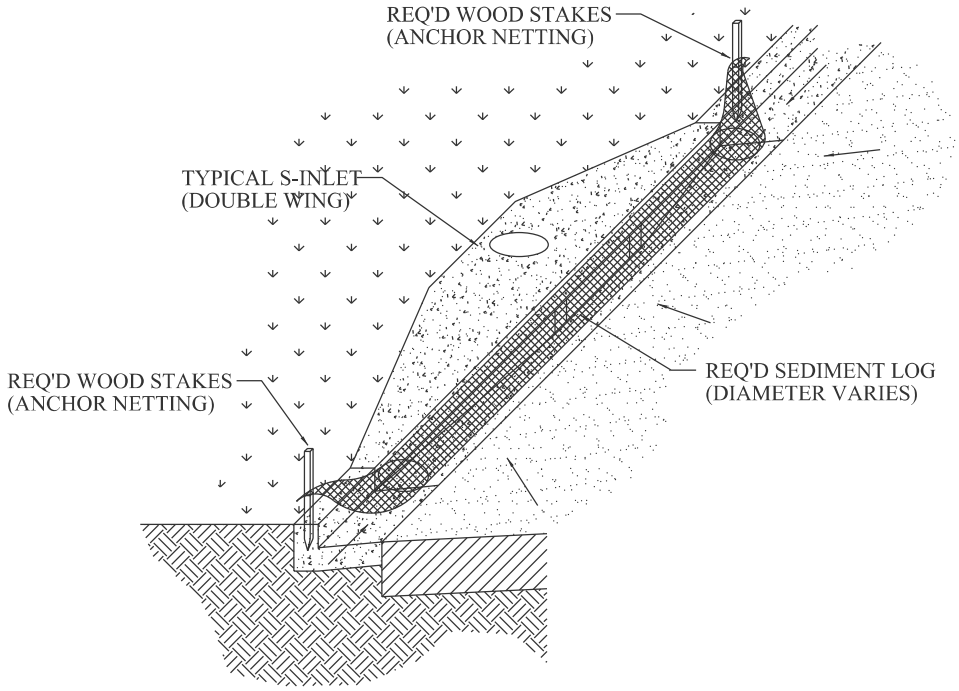

CURB INLET PROTECTION

NOT TO SCALE

NOTES:

1. WHEN STAKING THE SEDIMENT LOG THE WOODEN STAKES SHALL NOT PENETRATE THE SEDIMENT LOG MATERIAL. THE WOODEN STAKES SHALL ONLY EXTEND THROUGH THE SEDIMENT LOG NETTING.
2. SEDIMENT CONTROL LOGS SHALL BE CURLEX SEDIMENT LOGS AS MANUFACTURED BY AMERICAN EXCELSIOR COMPANY (AEC) OR APPROVED EQUAL.

OCE

CITY OF TUSCALOOSA

EROSION CONTROL
SEDIMENT CONTROL LOG

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	*DESCRIPTION*	*BY*

FILE NAME:		*APPROVED BY:*	*PAGE NO.*
DRAWN BY:	*FES*	*Jarrod D. Milligan, PE*	SD - 165
DATE:	*2011.01.05*	*Wastewater Engineer*	
SCALE:	*NOT TO SCALE*	*CITY OF TUSCALOOSA*	

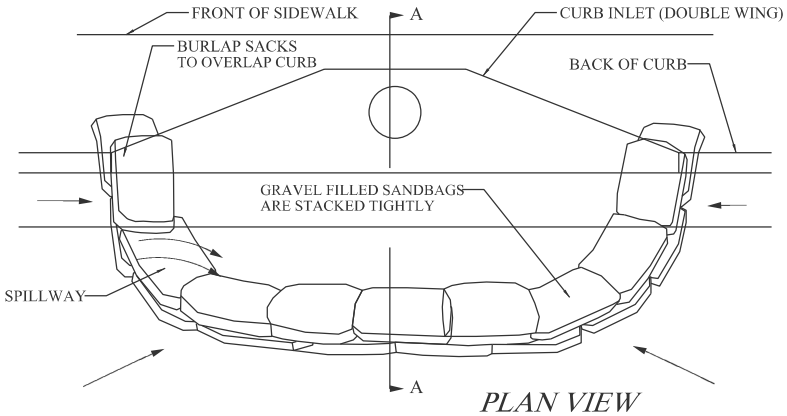

PLAN VIEW

NOT TO SCALE

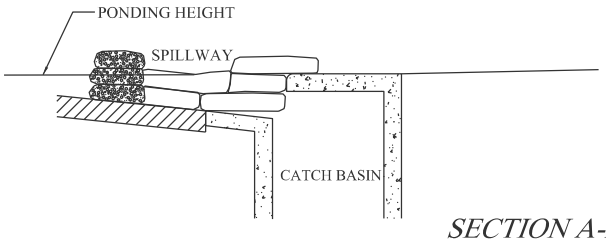

SECTION A-A

NOT TO SCALE

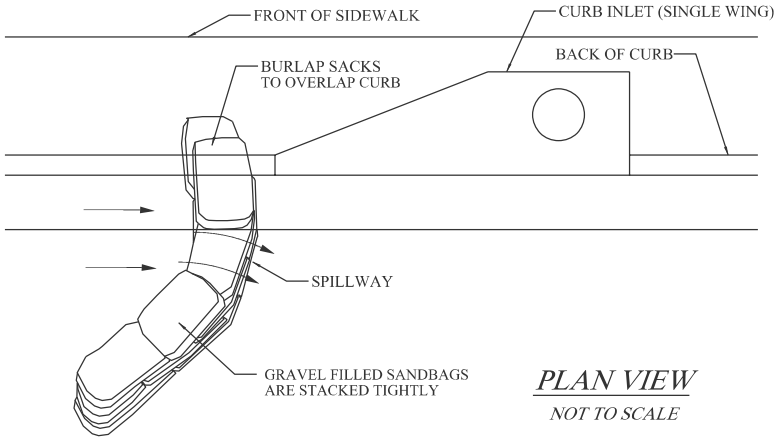

PLAN VIEW

NOT TO SCALE

NOTES:

1. PLACE CURB TYPE SEDIMENT BARRIERS ON GENTLY SLOPING STREET SEGMENTS, WHERE WATER CAN POND AND ALLOW SEDIMENT TO SEPARATE FROM RUNOFF.
2. SANDBAGS OF EITHER BURLAP OR WOVEN `GEOTEXTILE' FABRIC, ARE FILLED WITH GRAVEL, LAYERED AND PACKED TIGHTLY.
3. LEAVE A ONE SANDBAG GAP IN THE TOP ROW TO PROVIDE A SPILLWAY FOR OVERFLOW.
4. INSPECT BARRIERS AND REMOVE SEDIMENT AFTER EACH STORM EVENT. SEDIMENT AND GRAVEL MUST BE REMOVED FROM THE TRAVELED WAY IMMEDIATELY.

OCE

CITY OF TUSCALOOSA

EROSION CONTROL
CURB INLET PROTECTION (SANDBAGS)

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	*DESCRIPTION*	*BY*

FILE NAME:		*APPROVED BY:*	*PAGE NO.*
DRAWN BY:	*FES*	*Jarrod D. Milligan, PE*	SD - 170
DATE:	*2011.01.05*	*Wastewater Engineer*	
SCALE:	*NOT TO SCALE*	*CITY OF TUSCALOOSA*	

DO NOT DEPLOY IN A MANNER THAT SILT FENCES WILL ACT AS A DAM ACROSS PERMANENT FLOWING WATERCOURSES. SILT FENCES ARE TO BE USED AT UPLAND LOCATIONS.

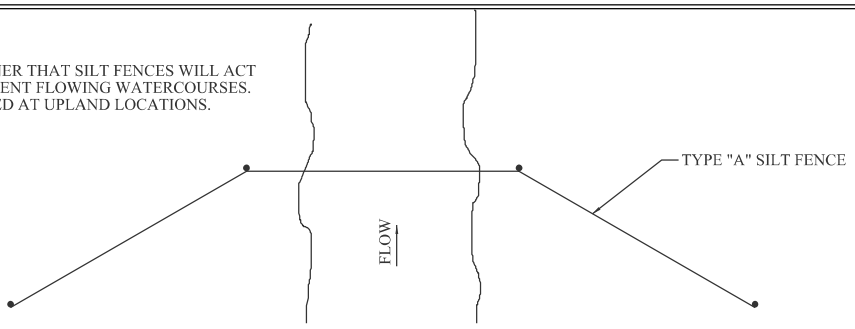

PLAN

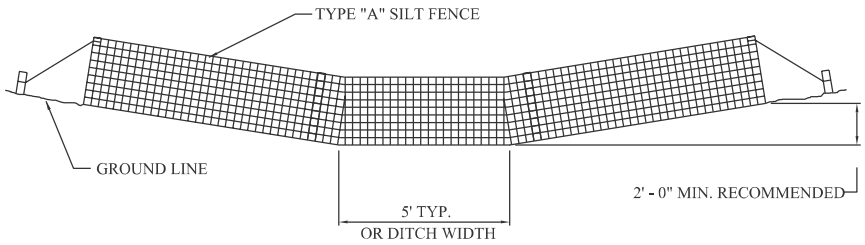

ELEVATION

SILT FENCE DITCH CHECK

NOT TO SCALE

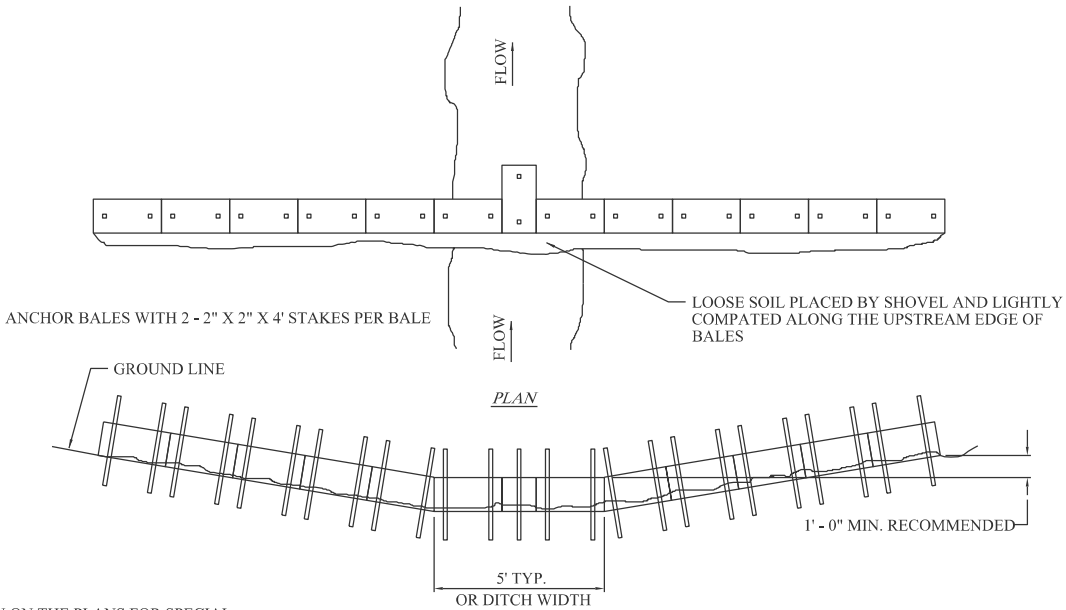

PLAN

ELEVATION

BALED HAY DITCH CHECK

NOT TO SCALE

NOTES:

1. SPACING SHALL BE AS SHOWN ON THE PLANS FOR SPECIAL AREA'S, OR AS DETERMINED BY THE ACTUAL PROJECT NEEDS TO MINIMIZE EROSION.
2. ADDITIONAL EROSION CONTROL METHODS WILL BE REQUIRED AT THE DITCH OUTLET TO CONTAIN SEDIMENT.

CITY OF TUSCALOOSA

EROSION CONTROL
SILT FENCE & BALED HAY DITCH CHECK

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	*DESCRIPTION*	*BY*

FILE NAME:		*APPROVED BY:*	*PAGE NO.*
DRAWN BY:	*FES*	*Jarrod D. Milligan, PE*	SD - 175
DATE:	*2011.01.05*	*Wastewater Engineer*	
SCALE:	*NOT TO SCALE*	*CITY OF TUSCALOOSA*	

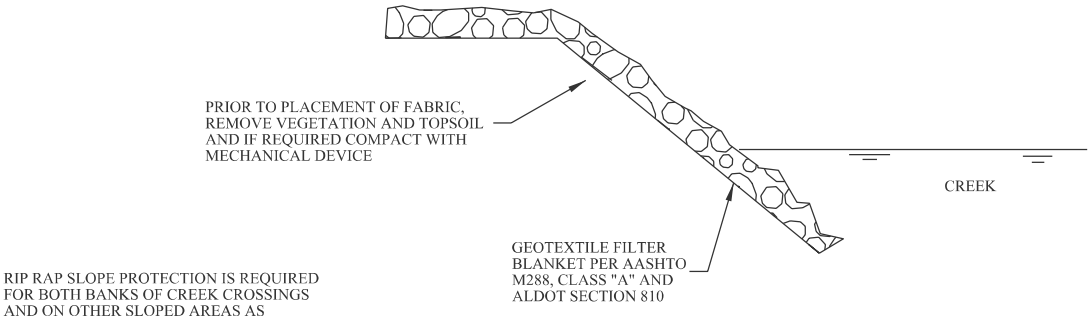

RIP RAP SLOPE PROTECTION IS REQUIRED FOR BOTH BANKS OF CREEK CROSSINGS AND ON OTHER SLOPED AREAS AS DIRECTED BY THE OCE.

RIP RAP SLOPE PROTECTION

NOT TO SCALE

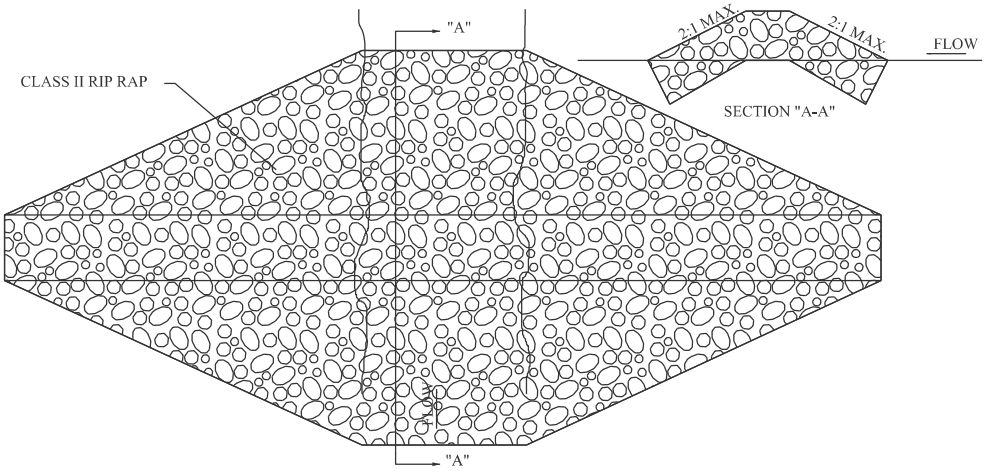

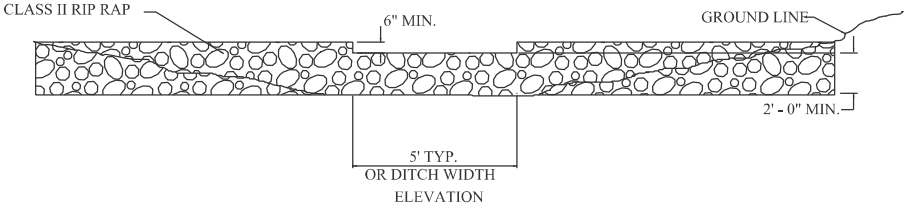

RIP RAP DITCH CHECK

NOT TO SCALE

NOTES:

1. SPACING SHALL BE AS SHOWN ON THE PLANS FOR SPECIAL AREA'S, OR AS DETERMINED BY THE ACTUAL PROJECT NEEDS TO MINIMIZE EROSION.
2. ADDITIONAL EROSION CONTROL METHODS WILL BE REQUIRED AT THE DITCH OUTLET TO CONTAIN SEDIMENT.

OCE

CITY OF TUSCALOOSA

EROSION CONTROL
RIPRAP DITCH CHECK / SLOPE PROTECTION

WASTEWATER ENGINEERING STANDARD DETAILS

REVISION

DATE	*DESCRIPTION*	*BY*

FILE NAME:		*APPROVED BY:*	*PAGE NO.*
DRAWN BY:	*FES*	*Jarrod D. Milligan, PE*	SD - 180
DATE:	*2011.01.05*	*Wastewater Engineer*	
SCALE:	*NOT TO SCALE*	*CITY OF TUSCALOOSA*	